CITY OF SAN DIEGO

Metropolitan Wastewater Department

Environmental Monitoring & Technical Services Division
Industrial Waste Laboratory

Report #1

WASTEWATER CHARACTERIZATION

CITY OF TECATE
BAJA CALIFORNIA, MEXICO

JANUARY 1 TO MAY 31, 2002

IBWC	**STATE OF**	**DGE**
CILA	**CALIFORNIA**	**CESPTE**

July 2, 2002

SAMPLING AND ANALYSIS
OF TECATE'S WASTEWATER

JANUARY 1 TO MAY 31, 2002

This report was submitted simultaneously to:

COMISION INTERNACIONAL DE DE LIMITES Y AGUAS (CILA) Tijuana Section	DIRECCION GENERAL DE ECOLOGIA DEL ESTADO DE BAJA CALIFORNIA (DGE)	COMISION ESTATAL SERVICIOS PUBLICOS DE TECATE (CESPTE)

The sampling was conducted by personnel from CESPTE , DGE, and the City of San Diego.

All analyses were performed by the City of San Diego.

SAMPLING SITES (See maps in the following pages)

1) Wastewater Treatment Plant Influent
2) Wastewater Treatment Plant Effluent
3) See map
4) See map
5) See map

SAMPLING EVENTS

A total of eleven sampling events were conducted during this period.

Feb 26-27 : sites 1,2
Mar 6-7 : sites 1,2
Mar 14-15: sites 1,2
Mar 22-23 : sites 1,2
Apr 7-8: sites 1,3
Apr 15-16: sites 1,3
Apr 23-24: sites 1,3
May 1-2: sites 1,3,4
May 9-10: sites 1,4
May 17-18: sites 1,4
May 25-26: sites 1,5

CHEMICAL ANALYSIS

Analysis type	Number of samples analyzed
pH	551
Conductivity	551
Total Suspended Solids	22
Ammonia-Nitrogen	22
Cyanide (Total +Amenable)	22
Biochemical Oxygen Demand	20
Chemical Oxygen Demand	22
Hexane Extractable Material (HEM)	22
HEM-Silica Gel Treated (HEM-SGT)	18
MBAS	18
Organophosphorus Pesticides	10
Organochlorine Pesticides	22
Volatile Organic Compounds	22
Semivolatile Organic Compounds	22
Metals by ICP-MS (incl. As, Se, Hg)	24

Sincerely,

ALAN C. LANGWORTHY
Deputy Director

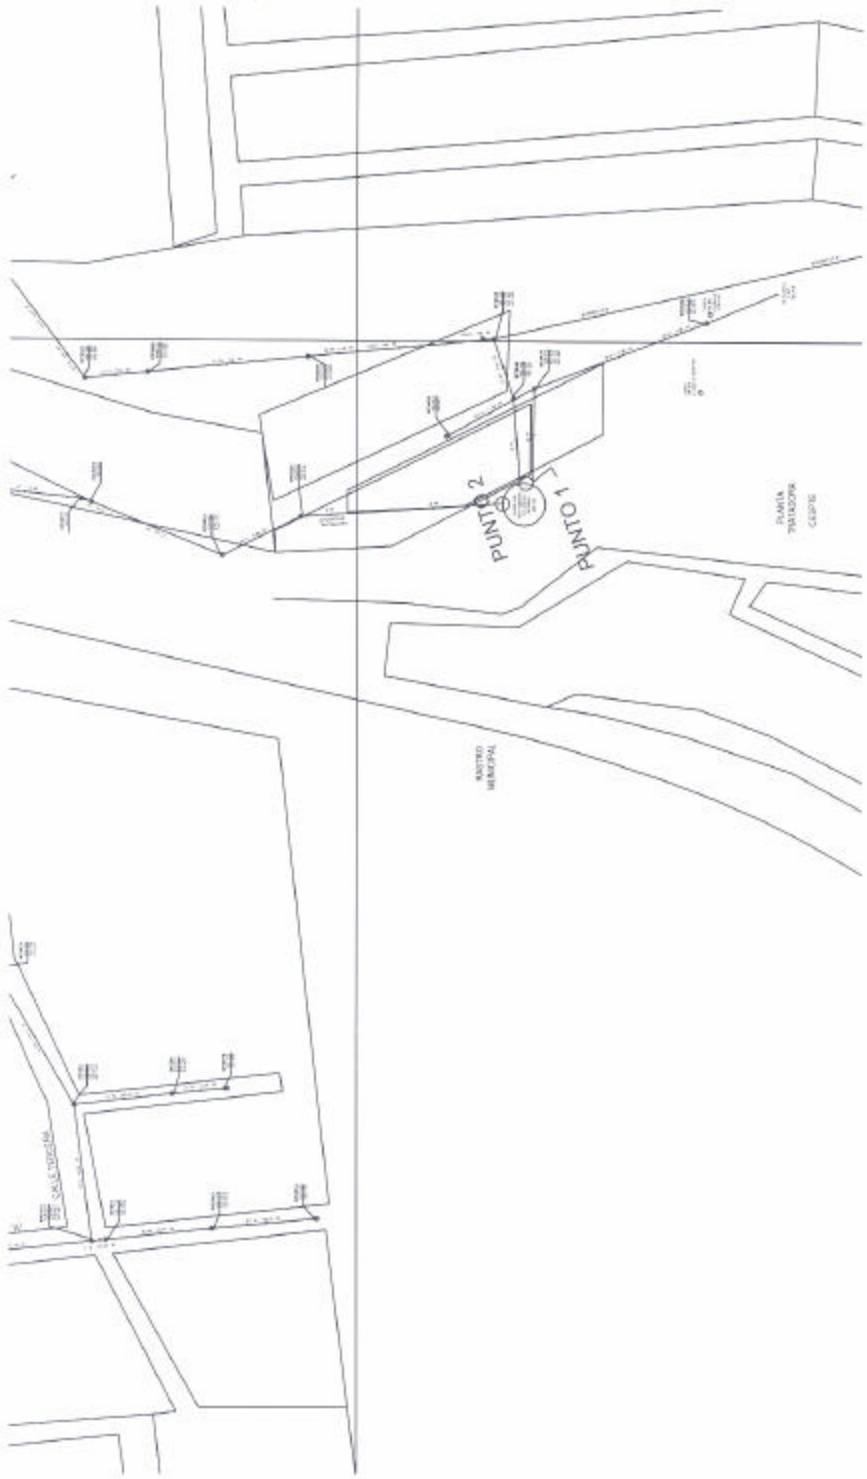
PUNTO 2
PUNTO 1

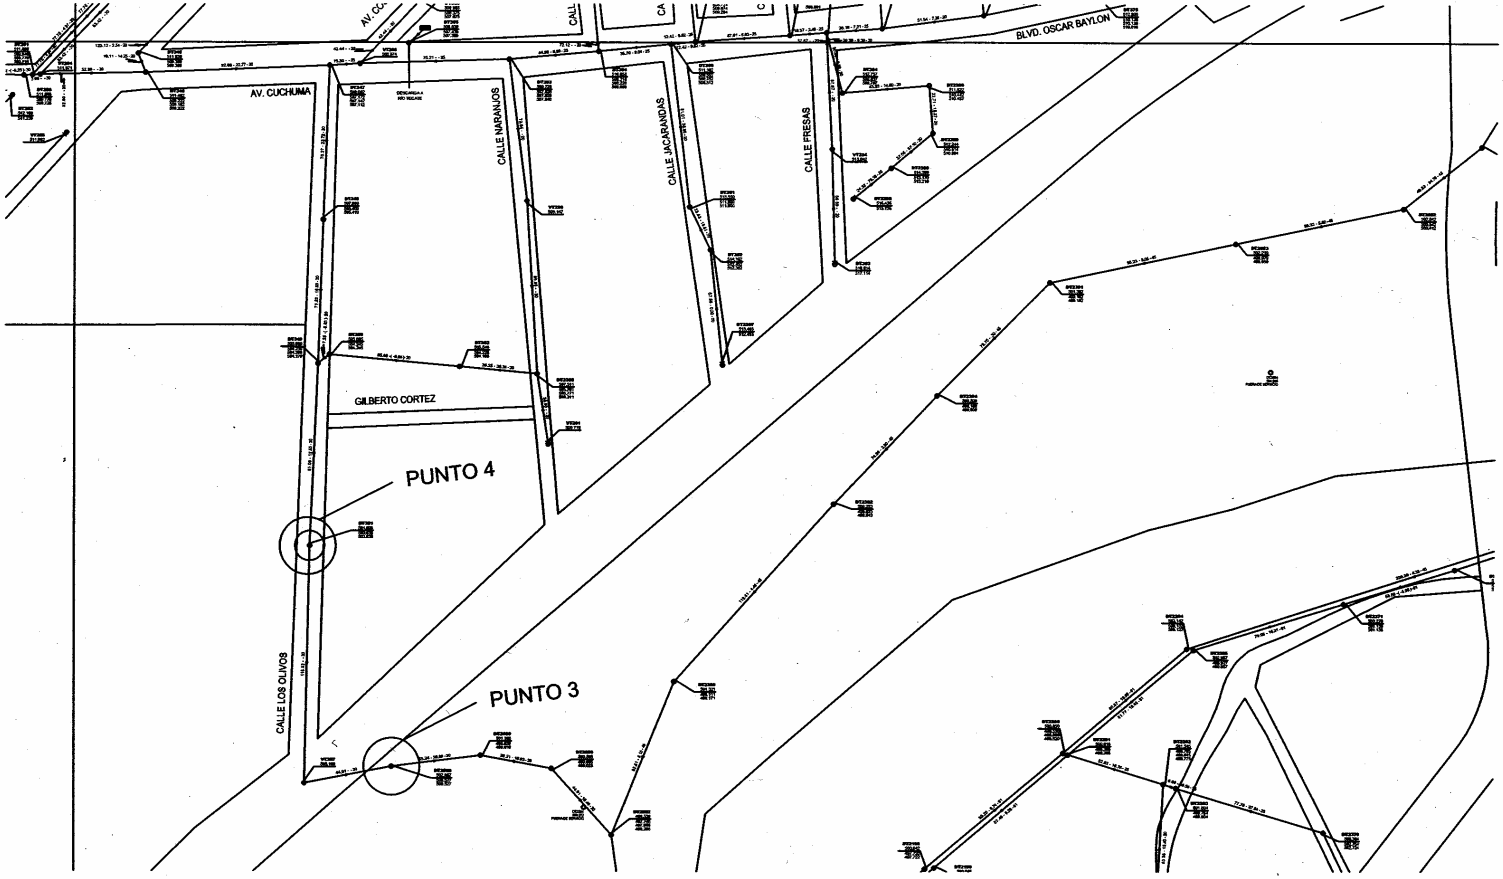
BLVD. OSCAR BAYLON
AV. CUCHUMA
CALLE NARANJOS
CALLE JACARANDAS
CALLE FRESAS
GILBERTO CORTEZ
PUNTO 4
PUNTO 3
CALLE LOS OLIVOS

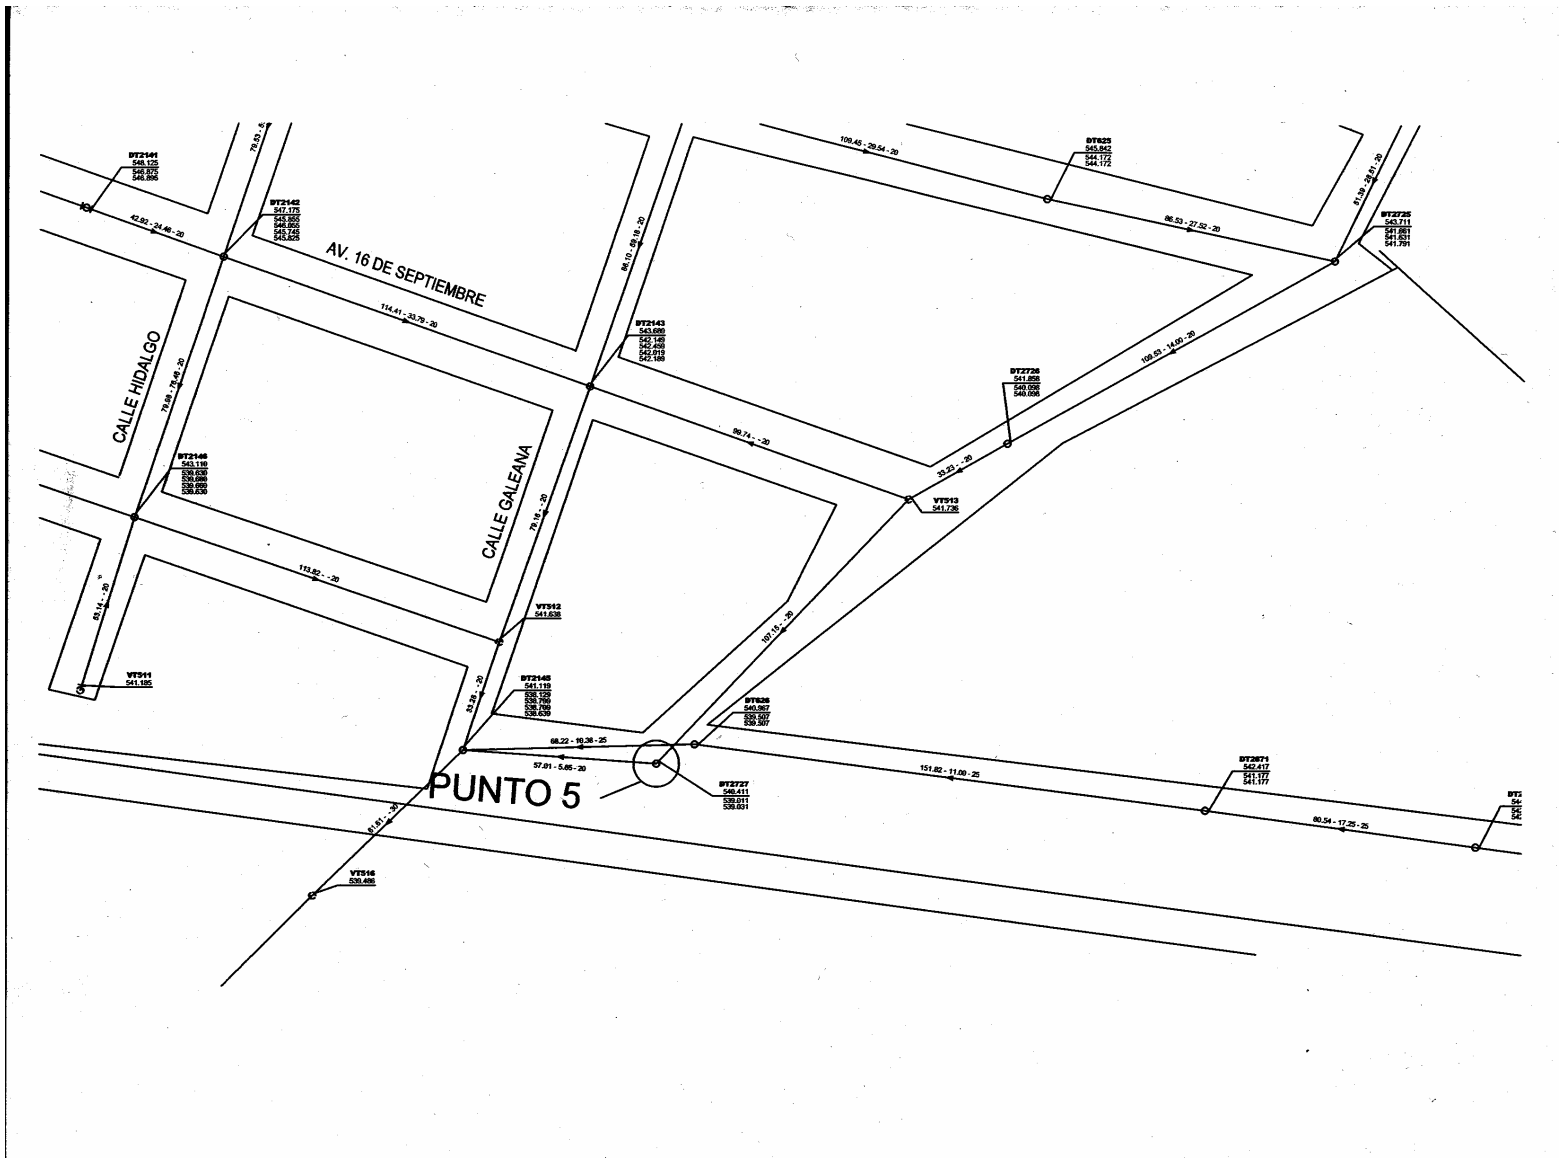
AV. 16 DE SEPTIEMBRE
CALLE HIDALGO
CALLE GALEANA
PUNTO 5
DT2141
DT2142
DT2143
DT2146
DT2145
DT2726
DT2727
DT2725
DT2671
DT625
DT626
VT511
VT512
VT513
VT516

SITE 1

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
26-FEB-02	TUESDAY	1_Hr_COMP	1300	Specific Conductance		1600	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1300	pH		7.8	pH
26-FEB-02	TUESDAY	1_Hr_COMP	1400	Specific Conductance		1700	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1400	pH		7.8	pH
26-FEB-02	TUESDAY	1_Hr_COMP	1500	Specific Conductance		1700	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1500	pH		7.7	pH
26-FEB-02	TUESDAY	1_Hr_COMP	1600	Specific Conductance		1800	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1600	pH		7.8	pH
26-FEB-02	TUESDAY	1_Hr_COMP	1700	Specific Conductance		1800	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1700	pH		7.8	pH
26-FEB-02	TUESDAY	1_Hr_COMP	1800	Specific Conductance		1900	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1800	pH		7.9	pH
26-FEB-02	TUESDAY	1_Hr_COMP	1900	Specific Conductance		1800	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1900	pH		7.8	pH
26-FEB-02	TUESDAY	1_Hr_COMP	2000	Specific Conductance		1900	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	2000	pH		7.8	pH
26-FEB-02	TUESDAY	1_Hr_COMP	2100	Specific Conductance		1900	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	2100	pH		7.8	pH
26-FEB-02	TUESDAY	1_Hr_COMP	2200	Specific Conductance		1800	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	2200	pH		8	pH
26-FEB-02	TUESDAY	1_Hr_COMP	2300	Specific Conductance		1900	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	2300	pH		8	pH
26-FEB-02	TUESDAY	1_Hr_COMP	2400	Specific Conductance		1900	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	2400	pH		8	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	100	Specific Conductance		1800	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	100	pH		8	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	200	Specific Conductance		1900	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	200	pH		8.1	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	300	Specific Conductance		1800	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	300	pH		7.9	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	400	Specific Conductance		1600	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	400	pH		7.9	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	500	Specific Conductance		1700	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	500	pH		7.9	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	600	Specific Conductance		2000	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	600	pH		7.7	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	700	Specific Conductance		2000	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	700	pH		8	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	800	Specific Conductance		3100	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	800	pH		8.3	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	900	Specific Conductance		3000	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	900	pH		8.4	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	1000	Specific Conductance		2800	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	1000	pH		8.3	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	1100	Specific Conductance		2100	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	1100	pH		8.2	pH
27-FEB-02	WEDNESDAY	COMP_AUTO_CN	1135	Total Cyanide	<	.02	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_COD	1135	Chemical Oxygen Demand		697	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Aluminum		1.41	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Antimony	<	.015	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Arsenic	<	.003	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Barium		.171	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Beryllium	<	.006	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Cadmium	<	.009	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Chromium		.024	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Copper		.07	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Lead	<	.02	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Manganese		.047	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Mercury	<	.002	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Nickel		.039	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Selenium	<	.003	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Silver		.008	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Thallium	<	.001	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1135	Zinc		.38	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_MBAS	1135	Methylene Blue Active Substances		23.2	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_NH3	1135	Ammonia as (N)		45.2	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_SOLID	1135	Total Suspended Solids		186	mg/L
27-FEB-02	WEDNESDAY	COMP_CONDUCT	1135	Specific Conductance		1800	umhos/cm
27-FEB-02	WEDNESDAY	COMP_PH	1135	pH		7.8	pH
27-FEB-02	WEDNESDAY	GRAB	1145	Specific Conductance		1900	umhos/cm

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
27-FEB-02	WEDNESDAY	GRAB	1145	pH		8	pH
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	1,2,4-trichlorobenzene	<	11.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	1,2-diphenylhydrazine	<	8.45	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	2,4,6-trichlorophenol	<	8.87	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	2,4-dimethylphenol	<	11	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	2,4-dinitrophenol	<	8.98	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	2,4-dinitrotoluene	<	6	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	2,4_dichlorophenol	<	9.32	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	2,6-dinitrotoluene	<	6.97	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	2-chloronaphthalene	<	7.64	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	2-chlorophenol	<	5	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	2-nitrophenol	<	9.22	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	3,3-dichlorobenzidine	<	9.99	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	4-bromophenyl phenyl ether	<	6.04	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	4-chloro-3-methylphenol	<	7.16	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	4-chlorophenyl phenyl ether	<	4.99	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	4-nitrophenol	<	4.9	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Acenaphthene	<	5.45	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Acenaphthylene	<	8.34	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Anthracene	<	7.16	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Benzidine	<	6.17	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Benzo(A)anthracene	<	5.2	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Benzo(A)pyrene	<	7.69	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Benzo(G,H,I)perylene	<	5.22	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Benzo(K)fluoranthene	<	7.9	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Benzo(b)fluoroanthene	<	6.98	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Bis-(2-ethylhexyl) phthalate		58.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Butyl benzyl phthalate	<	7.53	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Chrysene	<	4.04	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Di-n-Butyl phthalate	<	5.89	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Di-n-Octyl phthalate	<	9.17	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Dibenzo (A,H) Anthracene	<	7.66	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Diethyl Phthalate		15.9	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Dimethyl Phthalate	<	4.64	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Fluoranthene	<	4.68	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Fluorene	<	4.04	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Hexachlorobenzene	<	6.89	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Hexachlorobutadiene	<	9.17	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Hexachlorocyclopentadiene	<	8.87	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Hexachloroethane	<	5.27	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Isophorone	<	6	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	N-nitrosodi-n-propylamine	<	8.67	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	N-nitrosodimethylamine	<	5.4	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	N-nitrosodiphenylamine	<	5.01	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Naphthalene	<	7.47	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Nitrobenzene	<	7.92	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Pentachlorophenol	<	2.73	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Phenanthrene	<	4.76	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Phenol		109	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	Pyrene	<	4.86	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	bis(2-chloroethoxy)methane	<	10.4	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1145	bis(2-chloroethyl) ether	<	6.41	ug/L
27-FEB-02	WEDNESDAY	GRAB_OG	1145	Hexane Extraction Method		106	mg/L
27-FEB-02	WEDNESDAY	GRAB_OG	1145	SGT-HEM-Non Polar Material		11.9	mg/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Aldrin	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Alpha Endosulfan	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	BHC, Alpha	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	BHC, Beta	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	BHC, Delta	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	BHC, Gamma (Lindane)	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Beta Endosulfan	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Chlordane	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Chlorpyrifos	<	.05	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Demeton-O	<	.09	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Demeton-S	<	.05	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Diazinon		.074	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Dieldrin	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Endosulfan Sulfate	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Endrin	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Endrin aldehyde	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Guthion	<	.21	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Heptachlor	<	.1	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Heptachlor epoxide	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Malathion		.78	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	PCB 1016	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	PCB 1221	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	PCB 1232	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	PCB 1242	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	PCB 1248	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	PCB 1254	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	PCB 1260	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	PCB-1262	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Parathion	<	.03	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	Toxaphene	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	p,p-DDD	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	p,p-DDE	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1145	p,p-DDT	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	1,1,1-trichloroethane	<	.78	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	1,1,2,2-tetrachloroethane	<	3.13	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	1,1,2-trichloroethane	<	3.02	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	1,1-dichloroethane	<	.71	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	1,1-dichloroethene	<	1.09	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	1,2-dichlorobenzene	<	1.37	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	1,2-dichloroethane	<	2.24	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	1,2-dichloropropane	<	.83	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	1,3-dichlorobenzene	<	1.31	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	1,4-dichlorobenzene		7.83	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	2-chloroethylvinyl ether	<	1.35	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Benzene	<	.92	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Bromodichloromethane		1.99	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Bromoform	<	3.58	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Bromomethane	<	1.39	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Carbon tetrachloride	<	1.92	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Chlorobenzene	<	1	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Chloroethane	<	.95	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Chloroform		4.22	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Chloromethane	<	3.23	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Dibromochloromethane	<	1.99	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Ethylbenzene	<	1.46	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Methylene chloride		9.11	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Tetrachloroethene	<	1.04	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Toluene		3.66	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Trichloroethene	<	1.32	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Trichlorofluoromethane	<	3.92	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	Vinyl chloride	<	1.04	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	cis-1,3-dichloropropene	<	1.01	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	trans-1,2-dichloroethene	<	.61	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1145	trans-1,3-dichloropropene	<	1.27	ug/L
06-MAR-02	WEDNESDAY	1_Hr_COMP	1015	Specific Conductance		2000	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1015	pH		8.2	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1115	Specific Conductance		1900	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1115	pH		8	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1215	Specific Conductance		1900	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1215	pH		7.9	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1315	Specific Conductance		1900	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1315	pH		7.9	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1415	Specific Conductance		1900	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1415	pH		7.9	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1515	Specific Conductance		1900	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1515	pH		7.9	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1615	Specific Conductance		2000	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1615	pH		8.1	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1715	Specific Conductance		2000	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1715	pH		8	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1815	Specific Conductance		1900	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1815	pH		8	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1915	Specific Conductance		1900	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1915	pH		8.1	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	2015	Specific Conductance		1900	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	2015	pH		8.2	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	2115	Specific Conductance		1900	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	2115	pH		8.2	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	2215	Specific Conductance		1900	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	2215	pH		8.2	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	2315	Specific Conductance		2000	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	2315	pH		8.1	pH
07-MAR-02	THURSDAY	1_Hr_COMP	15	Specific Conductance		1900	umhos/cm

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
07-MAR-02	THURSDAY	1_Hr_COMP	15	pH		8.2	pH
07-MAR-02	THURSDAY	1_Hr_COMP	115	Specific Conductance		1800	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	115	pH		8.1	pH
07-MAR-02	THURSDAY	1_Hr_COMP	215	Specific Conductance		1800	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	215	pH		8	pH
07-MAR-02	THURSDAY	1_Hr_COMP	315	Specific Conductance		1700	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	315	pH		8	pH
07-MAR-02	THURSDAY	1_Hr_COMP	415	Specific Conductance		1900	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	415	pH		8	pH
07-MAR-02	THURSDAY	1_Hr_COMP	515	Specific Conductance		1700	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	515	pH		7.9	pH
07-MAR-02	THURSDAY	1_Hr_COMP	615	Specific Conductance		1700	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	615	pH		8	pH
07-MAR-02	THURSDAY	1_Hr_COMP	715	Specific Conductance		2100	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	715	pH		8.1	pH
07-MAR-02	THURSDAY	1_Hr_COMP	815	Specific Conductance		2100	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	815	pH		8.3	pH
07-MAR-02	THURSDAY	1_Hr_COMP	915	Specific Conductance		2100	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	915	pH		8.3	pH
07-MAR-02	THURSDAY	COMP_AUTO_BOD	1005	Biochemical Oxygen Demand (BOD)		316	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_CN	1005	Total Cyanide	<	.02	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_COD	1005	Chemical Oxygen Demand		718	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Aluminum		2.03	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Antimony	<	.015	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Arsenic	<	.003	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Barium		.591	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Cadmium	<	.009	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Chromium		.012	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Copper		.071	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Lead	<	.02	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Manganese		.047	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Mercury	<	.002	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Nickel		.013	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Selenium	<	.003	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Silver		.007	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Thallium	<	.001	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1005	Zinc		.755	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_MBAS	1005	Methylene Blue Active Substances		23.6	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_NH3	1005	Ammonia as (N)		43.6	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_SOLID	1005	Total Suspended Solids		226	mg/L
07-MAR-02	THURSDAY	COMP_CONDUCT	1005	Specific Conductance		1800	umhos/cm
07-MAR-02	THURSDAY	COMP_PH	1005	pH		8	pH
07-MAR-02	THURSDAY	GRAB	1010	Specific Conductance		2200	umhos/cm
07-MAR-02	THURSDAY	GRAB	1010	pH		8.2	pH
07-MAR-02	THURSDAY	GRAB_BNA	1010	1,2,4-trichlorobenzene	<	11.1	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	1,2-diphenylhydrazine	<	8.45	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	2,4,6-trichlorophenol	<	8.87	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	2,4-dimethylphenol	<	11	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	2,4-dinitrophenol	<	8.98	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	2,4-dinitrotoluene	<	6	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	2,4_dichlorophenol	<	9.32	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	2,6-dinitrotoluene	<	6.97	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	2-chloronaphthalene	<	7.64	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	2-chlorophenol	<	5	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	2-nitrophenol	<	9.22	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	3,3-dichlorobenzidine	<	9.99	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	4-bromophenyl phenyl ether	<	6.04	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	4-chloro-3-methylphenol	<	7.16	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	4-chlorophenyl phenyl ether	<	4.99	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	4-nitrophenol	<	4.9	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Acenaphthene	<	5.45	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Acenaphthylene	<	8.34	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Anthracene	<	7.16	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Benzidine	<	6.17	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Benzo(A)anthracene	<	5.2	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Benzo(A)pyrene	<	7.69	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Benzo(G,H,I)perylene	<	5.22	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Benzo(K)fluoranthene	<	7.9	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Benzo(b)fluoroanthene	<	6.98	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Bis-(2-ethylhexyl) phthalate		26.1	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Butyl benzyl phthalate	<	7.53	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Chrysene	<	4.04	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Di-n-Butyl phthalate	<	5.89	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
07-MAR-02	THURSDAY	GRAB_BNA	1010	Di-n-Octyl phthalate	<	9.17	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Dibenzo (A,H) Anthracene	<	7.66	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Diethyl Phthalate		10.5	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Dimethyl Phthalate	<	4.64	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Fluoranthene	<	4.68	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Fluorene	<	4.04	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Hexachlorobenzene	<	6.89	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Hexachlorobutadiene	<	9.17	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Hexachlorocyclopentadiene	<	8.87	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Hexachloroethane	<	5.27	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Isophorone	<	6	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	N-nitrosodi-n-propylamine	<	8.67	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	N-nitrosodimethylamine	<	5.4	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	N-nitrosodiphenylamine	<	5.01	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Naphthalene	<	7.47	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Nitrobenzene	<	7.92	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Pentachlorophenol	<	2.73	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Phenanthrene	<	4.76	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Phenol	<	2.43	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	Pyrene	<	4.86	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	bis(2-chloroethoxy)methane	<	10.4	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1010	bis(2-chloroethyl) ether	<	6.41	ug/L
07-MAR-02	THURSDAY	GRAB_OG	1010	Hexane Extraction Method		59.8	mg/L
07-MAR-02	THURSDAY	GRAB_OG	1010	SGT-HEM-Non Polar Material	<	5	mg/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	Aldrin	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	Alpha Endosulfan	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	BHC, Alpha	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	BHC, Beta	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	BHC, Delta	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	BHC, Gamma (Lindane)	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	Beta Endosulfan	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	Chlordane	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	Dieldrin	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	Endosulfan Sulfate	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	Endrin	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	Endrin aldehyde	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	Heptachlor	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	Heptachlor epoxide	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	PCB 1016	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	PCB 1221	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	PCB 1232	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	PCB 1242	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	PCB 1248	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	PCB 1254	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	PCB 1260	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	PCB-1262	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	Toxaphene	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	p,p-DDD	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	p,p-DDE	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1010	p,p-DDT	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	1,1,1-trichloroethane	<	.78	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	1,1,2,2-tetrachloroethane	<	3.13	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	1,1,2-trichloroethane	<	3.02	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	1,1-dichloroethane	<	.71	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	1,1-dichloroethene	<	1.09	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	1,2-dichlorobenzene	<	1.37	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	1,2-dichloroethane	<	2.24	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	1,2-dichloropropane	<	.83	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	1,3-dichlorobenzene	<	1.31	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	1,4-dichlorobenzene		8.14	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	2-chloroethylvinyl ether	<	1.35	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Benzene	<	.92	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Bromodichloromethane		1.8	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Bromoform	<	3.58	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Bromomethane	<	1.39	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Carbon tetrachloride	<	1.92	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Chlorobenzene	<	1	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Chloroethane	<	.95	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Chloroform		2.72	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Chloromethane	<	3.23	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Dibromochloromethane		2.88	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Ethylbenzene	<	1.46	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Methylene chloride	<	1.29	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Tetrachloroethene	<	1.04	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
07-MAR-02	THURSDAY	GRAB_VOC	1010	Toluene		3.33	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Trichloroethene	<	1.32	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Trichlorofluoromethane	<	3.92	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	Vinyl chloride	<	1.04	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	cis-1,3-dichloropropene	<	1.01	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	trans-1,2-dichloroethene	<	.61	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1010	trans-1,3-dichloropropene	<	1.27	ug/L
14-MAR-02	THURSDAY	1_Hr_COMP	830	Specific Conductance		1900	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	830	pH		7.9	pH
14-MAR-02	THURSDAY	1_Hr_COMP	930	Specific Conductance		1900	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	930	pH		8	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1030	Specific Conductance		1900	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1030	pH		7.9	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1130	Specific Conductance		1900	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1130	pH		7.8	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1230	Specific Conductance		1900	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1230	pH		7.9	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1330	Specific Conductance		1900	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1330	pH		7.9	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1430	Specific Conductance		2700	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1430	pH		8.1	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1530	Specific Conductance		2100	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1530	pH		8	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1630	Specific Conductance		1900	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1630	pH		8	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1730	Specific Conductance		1900	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1730	pH		7.9	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1830	Specific Conductance		2000	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1830	pH		7.9	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1930	Specific Conductance		2000	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1930	pH		8.1	pH
14-MAR-02	THURSDAY	1_Hr_COMP	2030	Specific Conductance		2000	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	2030	pH		8.2	pH
14-MAR-02	THURSDAY	1_Hr_COMP	2130	Specific Conductance		1900	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	2130	pH		8.2	pH
14-MAR-02	THURSDAY	1_Hr_COMP	2230	Specific Conductance		1900	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	2230	pH		8.3	pH
14-MAR-02	THURSDAY	1_Hr_COMP	2330	Specific Conductance		1800	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	2330	pH		8.4	pH
15-MAR-02	FRIDAY	1_Hr_COMP	30	Specific Conductance		1700	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	30	pH		8.3	pH
15-MAR-02	FRIDAY	1_Hr_COMP	130	Specific Conductance		1600	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	130	pH		8.3	pH
15-MAR-02	FRIDAY	1_Hr_COMP	230	Specific Conductance		1600	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	230	pH		8.3	pH
15-MAR-02	FRIDAY	1_Hr_COMP	330	Specific Conductance		1600	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	330	pH		8	pH
15-MAR-02	FRIDAY	1_Hr_COMP	430	Specific Conductance		1500	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	430	pH		8	pH
15-MAR-02	FRIDAY	1_Hr_COMP	530	Specific Conductance		1500	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	530	pH		7.9	pH
15-MAR-02	FRIDAY	1_Hr_COMP	630	Specific Conductance		1800	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	630	pH		8.1	pH
15-MAR-02	FRIDAY	1_Hr_COMP	730	Specific Conductance		1900	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	730	pH		8.3	pH
15-MAR-02	FRIDAY	COMP_AUTO_BOD	900	Biochemical Oxygen Demand (BOD)		112	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_CN	900	Total Cyanide	<	.02	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_COD	900	Chemical Oxygen Demand		777	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Aluminum		2.07	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Antimony	<	.015	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Arsenic	<	.003	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Barium		.272	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Beryllium	<	.006	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Cadmium	<	.009	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Chromium		.022	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Copper		.076	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Lead	<	.02	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Manganese		.046	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Mercury	<	.002	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Nickel		.019	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Selenium		.006	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Silver		.017	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Thallium		.001	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	900	Zinc		.698	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_MBAS	900	Methylene Blue Active Substances		22.8	mg/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
15-MAR-02	FRIDAY	COMP_AUTO_NH3	900	Ammonia as (N)		43.2	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_SOLID	900	Total Suspended Solids		260	mg/L
15-MAR-02	FRIDAY	COMP_CONDUCT	900	Specific Conductance		1700	umhos/cm
15-MAR-02	FRIDAY	COMP_PH	900	pH		8	pH
15-MAR-02	FRIDAY	GRAB	920	Specific Conductance		1800	umhos/cm
15-MAR-02	FRIDAY	GRAB	920	pH		7.5	pH
15-MAR-02	FRIDAY	GRAB_BNA	920	1,2,4-trichlorobenzene	<	11.1	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	1,2-diphenylhydrazine	<	8.45	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	2,4,6-trichlorophenol	<	8.87	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	2,4-dimethylphenol	<	11	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	2,4-dinitrophenol	<	8.98	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	2,4-dinitrotoluene	<	6	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	2,4_dichlorophenol	<	9.32	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	2,6-dinitrotoluene	<	6.97	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	2-chloronaphthalene	<	7.64	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	2-chlorophenol	<	5	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	2-nitrophenol	<	9.22	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	3,3-dichlorobenzidine	<	9.99	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	4-bromophenyl phenyl ether	<	6.04	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	4-chloro-3-methylphenol	<	7.16	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	4-chlorophenyl phenyl ether	<	4.99	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	4-nitrophenol	<	4.9	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Acenaphthene	<	5.45	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Acenaphthylene	<	8.34	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Anthracene	<	7.16	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Benzidine	<	6.17	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Benzo(A)anthracene	<	5.2	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Benzo(A)pyrene	<	7.69	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Benzo(G,H,I)perylene	<	5.22	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Benzo(K)fluoranthene	<	7.9	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Benzo(b)fluoroanthene	<	6.98	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Bis-(2-ethylhexyl) phthalate		45.4	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Butyl benzyl phthalate	<	7.53	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Chrysene	<	4.04	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Di-n-Butyl phthalate	<	5.89	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Di-n-Octyl phthalate	<	9.17	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Dibenzo (A,H) Anthracene	<	7.66	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Diethyl Phthalate		17.8	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Dimethyl Phthalate	<	4.64	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Fluoranthene	<	4.68	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Fluorene	<	4.04	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Hexachlorobenzene	<	6.89	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Hexachlorobutadiene	<	9.17	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Hexachlorocyclopentadiene	<	8.87	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Hexachloroethane	<	5.27	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Isophorone	<	6	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	N-nitrosodi-n-propylamine	<	8.67	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	N-nitrosodimethylamine	<	5.4	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	N-nitrosodiphenylamine	<	5.01	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Naphthalene	<	7.47	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Nitrobenzene	<	7.92	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Pentachlorophenol	<	2.73	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Phenanthrene	<	4.76	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Phenol		24.9	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	Pyrene	<	4.86	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	bis(2-chloroethoxy)methane	<	10.4	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	920	bis(2-chloroethyl) ether	<	6.41	ug/L
15-MAR-02	FRIDAY	GRAB_OG	920	Hexane Extraction Method		84.1	mg/L
15-MAR-02	FRIDAY	GRAB_OG	920	SGT-HEM-Non Polar Material		6.67	mg/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Aldrin	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Alpha Endosulfan	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	BHC, Alpha	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	BHC, Beta	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	BHC, Delta	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	BHC, Gamma (Lindane)	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Beta Endosulfan	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Chlordane	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Chlorpyrifos		.11	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Demeton-O	<	.09	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Demeton-S	<	.05	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Diazinon	<	.07	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Dieldrin	<	.1	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
15-MAR-02	FRIDAY	GRAB_PEST	920	Endosulfan Sulfate	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Endrin	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Endrin aldehyde	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Guthion	<	.21	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Heptachlor	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Heptachlor epoxide	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Malathion		.087	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	PCB 1016	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	PCB 1221	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	PCB 1232	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	PCB 1242	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	PCB 1248	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	PCB 1254	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	PCB 1260	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	PCB-1262	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Parathion	<	.03	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	Toxaphene	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	p,p-DDD	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	p,p-DDE	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	920	p,p-DDT	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	1,1,1-trichloroethane	<	.78	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	1,1,2,2-tetrachloroethane	<	3.13	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	1,1,2-trichloroethane	<	3.02	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	1,1-dichloroethane	<	.71	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	1,1-dichloroethene	<	1.09	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	1,2-dichlorobenzene		1.84	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	1,2-dichloroethane	<	2.24	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	1,2-dichloropropane	<	.83	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	1,3-dichlorobenzene	<	1.31	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	1,4-dichlorobenzene		7.86	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	2-chloroethylvinyl ether	<	1.35	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Benzene	<	.92	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Bromodichloromethane		1.83	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Bromoform	<	3.58	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Bromomethane	<	1.39	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Carbon tetrachloride	<	1.92	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Chlorobenzene	<	1	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Chloroethane	<	.95	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Chloroform		3.91	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Chloromethane	<	3.23	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Dibromochloromethane		2.07	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Ethylbenzene	<	1.46	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Methylene chloride	<	1.29	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Tetrachloroethene	<	1.04	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Toluene		2.83	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Trichloroethene	<	1.32	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Trichlorofluoromethane	<	3.92	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	Vinyl chloride	<	1.04	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	cis-1,3-dichloropropene	<	1.01	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	trans-1,2-dichloroethene	<	.61	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	920	trans-1,3-dichloropropene	<	1.27	ug/L
22-MAR-02	FRIDAY	1_Hr_COMP	800	Specific Conductance		1800	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	800	pH		6.6	pH
22-MAR-02	FRIDAY	1_Hr_COMP	900	Specific Conductance		2200	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	900	pH		6.9	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1000	Specific Conductance		2200	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1000	pH		7.1	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1100	Specific Conductance		2200	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1100	pH		7.2	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1200	Specific Conductance		2200	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1200	pH		7	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1300	Specific Conductance		2200	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1300	pH		6.8	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1400	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1400	pH		6.8	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1500	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1500	pH		6.7	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1600	Specific Conductance		2000	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1600	pH		6.8	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1700	Specific Conductance		2000	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1700	pH		6.8	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1800	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1800	pH		6.8	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1900	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1900	pH		6.9	pH

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
22-MAR-02	FRIDAY	1_Hr_COMP	2000	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	2000	pH		6.8	pH
22-MAR-02	FRIDAY	1_Hr_COMP	2100	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	2100	pH		6.9	pH
22-MAR-02	FRIDAY	1_Hr_COMP	2200	Specific Conductance		2000	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	2200	pH		6.9	pH
22-MAR-02	FRIDAY	1_Hr_COMP	2300	Specific Conductance		2000	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	2300	pH		6.8	pH
22-MAR-02	FRIDAY	1_Hr_COMP	2400	Specific Conductance		2000	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	2400	pH		6.9	pH
23-MAR-02	SATURDAY	1_Hr_COMP	100	Specific Conductance		2100	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	100	pH		6.8	pH
23-MAR-02	SATURDAY	1_Hr_COMP	200	Specific Conductance		2000	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	200	pH		6.8	pH
23-MAR-02	SATURDAY	1_Hr_COMP	300	Specific Conductance		2100	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	300	pH		6.8	pH
23-MAR-02	SATURDAY	1_Hr_COMP	400	Specific Conductance		1900	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	400	pH		6.7	pH
23-MAR-02	SATURDAY	1_Hr_COMP	500	Specific Conductance		1900	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	500	pH		6.8	pH
23-MAR-02	SATURDAY	1_Hr_COMP	600	Specific Conductance		1800	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	600	pH		6.9	pH
23-MAR-02	SATURDAY	1_Hr_COMP	700	Specific Conductance		1800	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	700	pH		6.8	pH
23-MAR-02	SATURDAY	COMP_AUTO_BOD	1000	Biochemical Oxygen Demand (BOD)		279	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_CN	1000	Total Cyanide	<	.02	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_COD	1000	Chemical Oxygen Demand		655	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Aluminum		1.48	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Antimony	<	.015	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Arsenic	<	.003	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Barium		.213	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Beryllium	<	.006	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Cadmium	<	.009	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Chromium		.017	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Copper		.065	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Lead	<	.02	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Manganese		.042	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Mercury	<	.002	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Nickel		.017	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Selenium		.007	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Silver		.007	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Thallium	<	.001	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1000	Zinc		.326	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_MBAS	1000	Methylene Blue Active Substances		22.2	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_NH3	1000	Ammonia as (N)		44.4	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_SOLID	1000	Total Suspended Solids		192	mg/L
23-MAR-02	SATURDAY	COMP_CONDUCT	1000	Specific Conductance		2000	umhos/cm
23-MAR-02	SATURDAY	COMP_PH	1000	pH		6.7	pH
23-MAR-02	SATURDAY	GRAB	1010	Specific Conductance		1900	umhos/cm
23-MAR-02	SATURDAY	GRAB	1010	pH		7.8	pH
23-MAR-02	SATURDAY	GRAB_BNA	1010	1,2,4-trichlorobenzene	<	11.1	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	1,2-diphenylhydrazine	<	8.45	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	2,4,6-trichlorophenol	<	8.87	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	2,4-dimethylphenol	<	11	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	2,4-dinitrophenol	<	8.98	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	2,4-dinitrotoluene	<	6	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	2,4_dichlorophenol	<	9.32	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	2,6-dinitrotoluene	<	6.97	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	2-chloronaphthalene	<	7.64	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	2-chlorophenol	<	5	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	2-nitrophenol	<	9.22	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	3,3-dichlorobenzidine	<	9.99	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	4-bromophenyl phenyl ether	<	6.04	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	4-chloro-3-methylphenol	<	7.16	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	4-chlorophenyl phenyl ether	<	4.99	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	4-nitrophenol	<	4.9	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Acenaphthene	<	5.45	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Acenaphthylene	<	8.34	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Anthracene	<	7.16	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Benzidine	<	6.17	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Benzo(A)anthracene	<	5.2	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Benzo(A)pyrene	<	7.69	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Benzo(G,H,I)perylene	<	5.22	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Benzo(K)fluoranthene	<	7.9	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
23-MAR-02	SATURDAY	GRAB_BNA	1010	Benzo(b)fluoroanthene	<	6.98	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Bis-(2-ethylhexyl) phthalate		52	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Butyl benzyl phthalate	<	7.53	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Chrysene	<	4.04	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Di-n-Butyl phthalate	<	5.89	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Di-n-Octyl phthalate	<	9.17	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Dibenzo (A,H) Anthracene	<	7.66	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Diethyl Phthalate		15.4	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Dimethyl Phthalate	<	4.64	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Fluoranthene	<	4.68	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Fluorene	<	4.04	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Hexachlorobenzene	<	6.89	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Hexachlorobutadiene	<	9.17	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Hexachlorocyclopentadiene	<	8.87	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Hexachloroethane	<	5.27	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Isophorone	<	6	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	N-nitrosodi-n-propylamine	<	8.67	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	N-nitrosodimethylamine	<	5.4	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	N-nitrosodiphenylamine	<	5.01	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Naphthalene	<	7.47	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Nitrobenzene	<	7.92	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Pentachlorophenol	<	2.73	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Phenanthrene	<	4.76	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Phenol		20.9	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	Pyrene	<	4.86	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	bis(2-chloroethoxy)methane	<	10.4	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1010	bis(2-chloroethyl) ether	<	6.41	ug/L
23-MAR-02	SATURDAY	GRAB_OG	1010	Hexane Extraction Method		82.2	mg/L
23-MAR-02	SATURDAY	GRAB_OG	1010	SGT-HEM-Non Polar Material		6.73	mg/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	Aldrin	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	Alpha Endosulfan	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	BHC, Alpha	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	BHC, Beta	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	BHC, Delta	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	BHC, Gamma (Lindane)	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	Beta Endosulfan	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	Chlordane	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	Dieldrin	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	Endosulfan Sulfate	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	Endrin	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	Endrin aldehyde	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	Heptachlor	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	Heptachlor epoxide	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	PCB 1016	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	PCB 1221	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	PCB 1232	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	PCB 1242	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	PCB 1248	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	PCB 1254	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	PCB 1260	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	PCB-1262	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	Toxaphene	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	p,p-DDD	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	p,p-DDE	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1010	p,p-DDT	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	1,1,1-trichloroethane	<	.78	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	1,1,2,2-tetrachloroethane	<	3.13	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	1,1,2-trichloroethane	<	3.02	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	1,1-dichloroethane	<	.71	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	1,1-dichloroethene	<	1.09	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	1,2-dichlorobenzene	<	1.37	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	1,2-dichloroethane	<	2.24	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	1,2-dichloropropane	<	.83	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	1,3-dichlorobenzene	<	1.31	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	1,4-dichlorobenzene		8.3	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	2-chloroethylvinyl ether	<	1.35	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Benzene	<	.92	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Bromodichloromethane		1.88	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Bromoform	<	3.58	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Bromomethane	<	1.39	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Carbon tetrachloride	<	1.92	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Chlorobenzene	<	1	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Chloroethane	<	.95	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
23-MAR-02	SATURDAY	GRAB_VOC	1010	Chloroform		3.81	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Chloromethane	<	3.23	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Dibromochloromethane		2.66	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Ethylbenzene	<	1.46	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Methylene chloride	<	1.29	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Tetrachloroethene	<	1.04	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Toluene		4.88	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Trichloroethene	<	1.32	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Trichlorofluoromethane	<	3.92	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	Vinyl chloride	<	1.04	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	cis-1,3-dichloropropene	<	1.01	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	trans-1,2-dichloroethene	<	.61	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1010	trans-1,3-dichloropropene	<	1.27	ug/L
07-APR-02	SUNDAY	1_Hr_COMP	900	Specific Conductance		1700	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	900	pH		8.9	pH
07-APR-02	SUNDAY	1_Hr_COMP	1000	Specific Conductance		1900	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1000	pH		9.2	pH
07-APR-02	SUNDAY	1_Hr_COMP	1100	Specific Conductance		2000	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1100	pH		9.7	pH
07-APR-02	SUNDAY	1_Hr_COMP	1200	Specific Conductance		1900	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1200	pH		9.8	pH
07-APR-02	SUNDAY	1_Hr_COMP	1300	Specific Conductance		1900	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1300	pH		10.1	pH
07-APR-02	SUNDAY	1_Hr_COMP	1400	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1400	pH		9.7	pH
07-APR-02	SUNDAY	1_Hr_COMP	1500	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1500	pH		9.5	pH
07-APR-02	SUNDAY	1_Hr_COMP	1600	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1600	pH		9.4	pH
07-APR-02	SUNDAY	1_Hr_COMP	1700	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1700	pH		9.4	pH
07-APR-02	SUNDAY	1_Hr_COMP	1800	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1800	pH		9.3	pH
07-APR-02	SUNDAY	1_Hr_COMP	1900	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1900	pH		9.3	pH
07-APR-02	SUNDAY	1_Hr_COMP	2000	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	2000	pH		9.4	pH
07-APR-02	SUNDAY	1_Hr_COMP	2100	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	2100	pH		9.4	pH
07-APR-02	SUNDAY	1_Hr_COMP	2200	Specific Conductance		2400	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	2200	pH		8.9	pH
07-APR-02	SUNDAY	1_Hr_COMP	2300	Specific Conductance		2400	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	2300	pH		8.9	pH
07-APR-02	SUNDAY	1_Hr_COMP	2400	Specific Conductance		2400	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	2400	pH		10	pH
08-APR-02	MONDAY	1_Hr_COMP	100	Specific Conductance		2400	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	100	pH		9.7	pH
08-APR-02	MONDAY	1_Hr_COMP	200	Specific Conductance		2400	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	200	pH		9.5	pH
08-APR-02	MONDAY	1_Hr_COMP	300	Specific Conductance		2400	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	300	pH		9.5	pH
08-APR-02	MONDAY	1_Hr_COMP	400	Specific Conductance		2400	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	400	pH		9.5	pH
08-APR-02	MONDAY	1_Hr_COMP	500	Specific Conductance		2400	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	500	pH		9.3	pH
08-APR-02	MONDAY	1_Hr_COMP	600	Specific Conductance		2400	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	600	pH		9.3	pH
08-APR-02	MONDAY	1_Hr_COMP	700	Specific Conductance		2400	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	700	pH		10.5	pH
08-APR-02	MONDAY	1_Hr_COMP	800	Specific Conductance		2400	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	800	pH		9.9	pH
08-APR-02	MONDAY	COMP_AUTO_BOD	950	Biochemical Oxygen Demand (BOD)		382	mg/L
08-APR-02	MONDAY	COMP_AUTO_CN	950	Total Cyanide	<	.02	mg/L
08-APR-02	MONDAY	COMP_AUTO_COD	950	Chemical Oxygen Demand		852	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Aluminum		2.05	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Antimony	<	.015	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Arsenic		.005	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Barium		.363	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Beryllium	<	.006	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Cadmium	<	.009	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Chromium		.016	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Copper		.087	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Lead	<	.02	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Manganese		.05	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Mercury	<	.002	mg/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
08-APR-02	MONDAY	COMP_AUTO_HM	950	Nickel		.103	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Selenium		.006	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Silver	<	.006	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Thallium	<	.001	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	950	Zinc		.866	mg/L
08-APR-02	MONDAY	COMP_AUTO_MBAS	950	Methylene Blue Active Substances		16.7	mg/L
08-APR-02	MONDAY	COMP_AUTO_NH3	950	Ammonia as (N)		32.5	mg/L
08-APR-02	MONDAY	COMP_AUTO_SOLID	950	Total Suspended Solids		276	mg/L
08-APR-02	MONDAY	COMP_CONDUCT	950	Specific Conductance		1800	umhos/cm
08-APR-02	MONDAY	COMP_PH	950	pH		9.5	pH
08-APR-02	MONDAY	GRAB	1000	Specific Conductance		2000	umhos/cm
08-APR-02	MONDAY	GRAB	1000	pH		8.6	pH
08-APR-02	MONDAY	GRAB_BNA	1000	1,2,4-trichlorobenzene	<	11.1	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	1,2-diphenylhydrazine	<	8.45	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	2,4,6-trichlorophenol	<	8.87	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	2,4-dimethylphenol	<	11	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	2,4-dinitrophenol	<	8.98	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	2,4-dinitrotoluene	<	6	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	2,4_dichlorophenol	<	9.32	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	2,6-dinitrotoluene	<	6.97	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	2-chloronaphthalene	<	7.64	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	2-chlorophenol	<	5	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	2-nitrophenol	<	9.22	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	3,3-dichlorobenzidine	<	9.99	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	4-bromophenyl phenyl ether	<	6.04	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	4-chloro-3-methylphenol	<	7.16	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	4-chlorophenyl phenyl ether	<	4.99	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	4-nitrophenol	<	4.9	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Acenaphthene	<	5.45	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Acenaphthylene	<	8.34	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Anthracene	<	7.16	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Benzidine	<	6.17	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Benzo(A)anthracene	<	5.2	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Benzo(A)pyrene	<	7.69	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Benzo(G,H,I)perylene	<	5.22	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Benzo(K)fluoranthene	<	7.9	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Benzo(b)fluoroanthene	<	6.98	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Bis-(2-ethylhexyl) phthalate		77.4	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Butyl benzyl phthalate	<	7.53	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Chrysene	<	4.04	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Di-n-Butyl phthalate		19.8	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Di-n-Octyl phthalate	<	9.17	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Dibenzo (A,H) Anthracene	<	7.66	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Diethyl Phthalate		31.4	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Dimethyl Phthalate	<	4.64	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Fluoranthene	<	4.68	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Fluorene	<	4.04	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Hexachlorobenzene	<	6.89	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Hexachlorobutadiene	<	9.17	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Hexachlorocyclopentadiene	<	8.87	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Hexachloroethane	<	5.27	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Isophorone	<	6	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	N-nitrosodi-n-propylamine	<	8.67	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	N-nitrosodimethylamine	<	5.4	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	N-nitrosodiphenylamine	<	5.01	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Naphthalene	<	7.47	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Nitrobenzene	<	7.92	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Pentachlorophenol	<	2.73	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Phenanthrene	<	4.76	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Phenol		110	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	Pyrene	<	4.86	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	bis(2-chloroethoxy)methane	<	10.4	ug/L
08-APR-02	MONDAY	GRAB_BNA	1000	bis(2-chloroethyl) ether	<	6.41	ug/L
08-APR-02	MONDAY	GRAB_OG	1000	Hexane Extraction Method		168	mg/L
08-APR-02	MONDAY	GRAB_OG	1000	SGT-HEM-Non Polar Material		6.37	mg/L
08-APR-02	MONDAY	GRAB_PEST	1000	Aldrin	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Alpha Endosulfan	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	BHC, Alpha	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	BHC, Beta	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	BHC, Delta	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	BHC, Gamma (Lindane)	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Beta Endosulfan	<	.1	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
08-APR-02	MONDAY	GRAB_PEST	1000	Chlordane	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Chlorpyrifos	<	.05	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Demeton-O	<	.09	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Demeton-S	<	.05	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Diazinon		.16	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Dieldrin	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Endosulfan Sulfate	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Endrin	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Endrin aldehyde	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Guthion	<	.21	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Heptachlor	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Heptachlor epoxide	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Malathion		.074	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	PCB 1016	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	PCB 1221	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	PCB 1232	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	PCB 1242	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	PCB 1248	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	PCB 1254	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	PCB 1260	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	PCB-1262	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Parathion	<	.03	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	Toxaphene	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	p,p-DDD	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	p,p-DDE	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1000	p,p-DDT	<	.1	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	1,1,1-trichloroethane	<	.78	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	1,1,2,2-tetrachloroethane	<	3.13	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	1,1,2-trichloroethane	<	3.02	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	1,1-dichloroethane	<	.71	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	1,1-dichloroethene	<	1.09	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	1,2-dichlorobenzene	<	1.37	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	1,2-dichloroethane	<	2.24	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	1,2-dichloropropane	<	.83	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	1,3-dichlorobenzene	<	1.31	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	1,4-dichlorobenzene		6.89	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	2-chloroethylvinyl ether	<	1.35	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Benzene	<	.81	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Bromodichloromethane	<	1.79	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Bromoform	<	3.58	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Bromomethane	<	1.39	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Carbon tetrachloride	<	1.92	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Chlorobenzene	<	1	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Chloroethane	<	.95	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Chloroform		1.91	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Chloromethane	<	3.23	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Dibromochloromethane		2.36	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Ethylbenzene	<	1.46	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Methylene chloride	<	1.29	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Tetrachloroethene	<	1.04	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Toluene		1.99	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Trichloroethene	<	1.32	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Trichlorofluoromethane	<	3.92	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	Vinyl chloride	<	1.04	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	cis-1,3-dichloropropene	<	1.01	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	trans-1,2-dichloroethene	<	.61	ug/L
08-APR-02	MONDAY	GRAB_VOC	1000	trans-1,3-dichloropropene	<	1.27	ug/L
15-APR-02	MONDAY	1_Hr_COMP	840	Specific Conductance		1700	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	840	pH		8.1	pH
15-APR-02	MONDAY	1_Hr_COMP	940	Specific Conductance		1700	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	940	pH		8.1	pH
15-APR-02	MONDAY	1_Hr_COMP	1040	Specific Conductance		1800	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1040	pH		7.9	pH
15-APR-02	MONDAY	1_Hr_COMP	1140	Specific Conductance		1800	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1140	pH		7.8	pH
15-APR-02	MONDAY	1_Hr_COMP	1240	Specific Conductance		1100	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1240	pH		7.7	pH
15-APR-02	MONDAY	1_Hr_COMP	1340	Specific Conductance		1700	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1340	pH		7.7	pH
15-APR-02	MONDAY	1_Hr_COMP	1440	Specific Conductance		1800	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1440	pH		7.7	pH
15-APR-02	MONDAY	1_Hr_COMP	1540	Specific Conductance		1800	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1540	pH		7.7	pH
15-APR-02	MONDAY	1_Hr_COMP	1640	Specific Conductance		1800	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1640	pH		7.8	pH

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
15-APR-02	MONDAY	1_Hr_COMP	1740	Specific Conductance		1800	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1740	pH		7.8	pH
15-APR-02	MONDAY	1_Hr_COMP	1840	Specific Conductance		1900	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1840	pH		7.8	pH
15-APR-02	MONDAY	1_Hr_COMP	1940	Specific Conductance		1900	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1940	pH		7.9	pH
15-APR-02	MONDAY	1_Hr_COMP	2040	Specific Conductance		1900	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	2040	pH		8	pH
15-APR-02	MONDAY	1_Hr_COMP	2140	Specific Conductance		1900	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	2140	pH		8.1	pH
15-APR-02	MONDAY	1_Hr_COMP	2240	Specific Conductance		1800	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	2240	pH		8.2	pH
15-APR-02	MONDAY	1_Hr_COMP	2340	Specific Conductance		1800	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	2340	pH		8	pH
16-APR-02	TUESDAY	1_Hr_COMP	40	Specific Conductance		1900	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	40	pH		8	pH
16-APR-02	TUESDAY	1_Hr_COMP	140	Specific Conductance		1700	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	140	pH		8	pH
16-APR-02	TUESDAY	1_Hr_COMP	240	Specific Conductance		1700	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	240	pH		7.9	pH
16-APR-02	TUESDAY	1_Hr_COMP	340	Specific Conductance		1600	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	340	pH		7.9	pH
16-APR-02	TUESDAY	1_Hr_COMP	440	Specific Conductance		1400	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	440	pH		7.9	pH
16-APR-02	TUESDAY	1_Hr_COMP	540	Specific Conductance		1500	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	540	pH		7.9	pH
16-APR-02	TUESDAY	1_Hr_COMP	640	Specific Conductance		1500	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	640	pH		8.1	pH
16-APR-02	TUESDAY	1_Hr_COMP	740	Specific Conductance		1900	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	740	pH		8.5	pH
16-APR-02	TUESDAY	COMP_AUTO_BOD	950	Biochemical Oxygen Demand (BOD)		245	mg/L
16-APR-02	TUESDAY	COMP_AUTO_CN	950	Total Cyanide	<	.02	mg/L
16-APR-02	TUESDAY	COMP_AUTO_COD	950	Chemical Oxygen Demand		596	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Aluminum		1.13	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Antimony	<	.015	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Arsenic	<	.003	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Barium		.672	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Beryllium	<	.006	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Cadmium	<	.009	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Chromium	<	.009	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Copper		.072	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Lead	<	.02	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Manganese		.038	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Mercury	<	.002	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Nickel	<	.012	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Selenium		.006	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Silver		.007	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Thallium	<	.001	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	950	Zinc		.56	mg/L
16-APR-02	TUESDAY	COMP_AUTO_MBAS	950	Methylene Blue Active Substances		15.7	mg/L
16-APR-02	TUESDAY	COMP_AUTO_NH3	950	Ammonia as (N)		52	mg/L
16-APR-02	TUESDAY	COMP_AUTO_SOLID	950	Total Suspended Solids		118	mg/L
16-APR-02	TUESDAY	COMP_CONDUCT	950	Specific Conductance		1700	umhos/cm
16-APR-02	TUESDAY	COMP_PH	950	pH		8	pH
16-APR-02	TUESDAY	GRAB	1000	Specific Conductance		1900	umhos/cm
16-APR-02	TUESDAY	GRAB	1000	pH		7.9	pH
16-APR-02	TUESDAY	GRAB_BNA	1000	1,2,4-trichlorobenzene	<	11.1	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	1,2-diphenylhydrazine	<	8.45	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	2,4,6-trichlorophenol	<	8.87	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	2,4-dimethylphenol	<	11	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	2,4-dinitrophenol	<	8.98	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	2,4-dinitrotoluene	<	6	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	2,4_dichlorophenol	<	9.32	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	2,6-dinitrotoluene	<	6.97	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	2-chloronaphthalene	<	7.64	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	2-chlorophenol	<	5	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	2-nitrophenol	<	9.22	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	3,3-dichlorobenzidine	<	9.99	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	4-bromophenyl phenyl ether	<	6.04	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	4-chloro-3-methylphenol	<	7.16	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	4-chlorophenyl phenyl ether	<	4.99	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	4-nitrophenol	<	4.9	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Acenaphthene	<	5.45	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Acenaphthylene	<	8.34	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
16-APR-02	TUESDAY	GRAB_BNA	1000	Anthracene	<	7.16	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Benzidine	<	6.17	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Benzo(A)anthracene	<	5.2	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Benzo(A)pyrene	<	7.69	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Benzo(G,H,I)perylene	<	5.22	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Benzo(K)fluoranthene	<	7.9	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Benzo(b)fluoroanthene	<	6.98	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Bis-(2-ethylhexyl) phthalate		49.7	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Butyl benzyl phthalate	<	7.53	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Chrysene	<	4.04	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Di-n-Butyl phthalate	<	5.89	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Di-n-Octyl phthalate	<	9.17	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Dibenzo (A,H) Anthracene	<	7.66	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Diethyl Phthalate		14.6	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Dimethyl Phthalate	<	4.64	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Fluoranthene	<	4.68	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Fluorene	<	4.04	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Hexachlorobenzene	<	6.89	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Hexachlorobutadiene	<	9.17	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Hexachlorocyclopentadiene	<	8.87	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Hexachloroethane	<	5.27	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Isophorone	<	6	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	N-nitrosodi-n-propylamine	<	8.67	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	N-nitrosodimethylamine	<	5.4	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	N-nitrosodiphenylamine	<	5.01	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Naphthalene	<	7.47	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Nitrobenzene	<	7.92	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Pentachlorophenol	<	2.73	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Phenanthrene	<	4.76	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Phenol		105	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	Pyrene	<	4.86	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	bis(2-chloroethoxy)methane	<	10.4	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1000	bis(2-chloroethyl) ether	<	6.41	ug/L
16-APR-02	TUESDAY	GRAB_OG	1000	Hexane Extraction Method		198	mg/L
16-APR-02	TUESDAY	GRAB_OG	1000	SGT-HEM-Non Polar Material		15.6	mg/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Aldrin	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Alpha Endosulfan	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	BHC, Alpha	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	BHC, Beta	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	BHC, Delta	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	BHC, Gamma (Lindane)	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Beta Endosulfan	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Chlordane	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Chlorpyrifos		.059	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Demeton-O	<	.09	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Demeton-S	<	.05	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Diazinon		.074	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Dieldrin	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Endosulfan Sulfate	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Endrin	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Endrin aldehyde	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Guthion	<	.21	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Heptachlor	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Heptachlor epoxide	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Malathion		.61	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	PCB 1016	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	PCB 1221	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	PCB 1232	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	PCB 1242	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	PCB 1248	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	PCB 1254	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	PCB 1260	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	PCB-1262	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Parathion	<	.03	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	Toxaphene	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	p,p-DDD	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	p,p-DDE	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1000	p,p-DDT	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	1,1,1-trichloroethane	<	.78	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	1,1,2,2-tetrachloroethane	<	3.13	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	1,1,2-trichloroethane	<	3.02	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	1,1-dichloroethane	<	.71	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	1,1-dichloroethene	<	1.09	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
16-APR-02	TUESDAY	GRAB_VOC	1000	1,2-dichlorobenzene	<	1.37	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	1,2-dichloroethane	<	2.24	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	1,2-dichloropropane	<	.83	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	1,3-dichlorobenzene	<	1.31	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	1,4-dichlorobenzene		3.69	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	2-chloroethylvinyl ether	<	1.35	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Benzene	<	.81	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Bromodichloromethane	<	1.79	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Bromoform	<	3.58	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Bromomethane	<	1.39	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Carbon tetrachloride	<	1.92	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Chlorobenzene	<	1	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Chloroethane	<	.95	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Chloroform		2.6	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Chloromethane	<	3.23	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Dibromochloromethane	<	1.99	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Ethylbenzene	<	1.46	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Methylene chloride		1.34	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Tetrachloroethene	<	1.04	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Toluene		3.46	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Trichloroethene	<	1.32	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Trichlorofluoromethane	<	3.92	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	Vinyl chloride	<	1.04	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	cis-1,3-dichloropropene	<	1.01	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	trans-1,2-dichloroethene	<	.61	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1000	trans-1,3-dichloropropene	<	1.27	ug/L
23-APR-02	TUESDAY	1_Hr_COMP	945	Specific Conductance		2100	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	945	pH		7.9	pH
23-APR-02	TUESDAY	1_Hr_COMP	1045	Specific Conductance		1900	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1045	pH		7.9	pH
23-APR-02	TUESDAY	1_Hr_COMP	1145	Specific Conductance		1900	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1145	pH		7.7	pH
23-APR-02	TUESDAY	1_Hr_COMP	1245	Specific Conductance		1900	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1245	pH		7.9	pH
23-APR-02	TUESDAY	1_Hr_COMP	1345	Specific Conductance		1800	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1345	pH		7.9	pH
23-APR-02	TUESDAY	1_Hr_COMP	1445	Specific Conductance		1400	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1445	pH		7.9	pH
23-APR-02	TUESDAY	1_Hr_COMP	1545	Specific Conductance		1700	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1545	pH		7.9	pH
23-APR-02	TUESDAY	1_Hr_COMP	1645	Specific Conductance		1900	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1645	pH		7.9	pH
23-APR-02	TUESDAY	1_Hr_COMP	1745	Specific Conductance		1900	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1745	pH		8	pH
23-APR-02	TUESDAY	1_Hr_COMP	1845	Specific Conductance		1900	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1845	pH		8	pH
23-APR-02	TUESDAY	1_Hr_COMP	1945	Specific Conductance		2000	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1945	pH		8	pH
23-APR-02	TUESDAY	1_Hr_COMP	2045	Specific Conductance		2000	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	2045	pH		8	pH
23-APR-02	TUESDAY	1_Hr_COMP	2145	Specific Conductance		1900	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	2145	pH		8	pH
23-APR-02	TUESDAY	1_Hr_COMP	2245	Specific Conductance		1900	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	2245	pH		8	pH
23-APR-02	TUESDAY	1_Hr_COMP	2345	Specific Conductance		1900	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	2345	pH		8.1	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	45	Specific Conductance		1900	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	45	pH		8.1	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	145	Specific Conductance		1900	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	145	pH		8.1	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	245	Specific Conductance		2000	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	245	pH		8.1	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	345	Specific Conductance		1900	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	345	pH		8.1	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	445	Specific Conductance		1700	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	445	pH		8	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	545	Specific Conductance		1700	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	545	pH		8.2	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	645	Specific Conductance		2000	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	645	pH		8.4	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	745	Specific Conductance		2200	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	745	pH		8.6	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	845	Specific Conductance		2200	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	845	pH		8.6	pH
24-APR-02	WEDNESDAY	COMP_AUTO_BOD	1020	Biochemical Oxygen Demand (BOD)		295	mg/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
24-APR-02	WEDNESDAY	COMP_AUTO_CN	1020	Total Cyanide	<	.02	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_COD	1020	Chemical Oxygen Demand		754	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Aluminum		2.07	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Antimony	<	.015	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Arsenic		.006	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Barium		.299	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Beryllium	<	.006	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Cadmium	<	.009	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Chromium		.02	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Copper		.095	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Lead	<	.02	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Manganese		.06	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Mercury		.002	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Nickel		.039	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Selenium		.004	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Silver		.011	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Thallium	<	.001	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1020	Zinc		.459	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_MBAS	1020	Methylene Blue Active Substances		19.2	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_NH3	1020	Ammonia as (N)		45.6	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_SOLID	1020	Total Suspended Solids		238	mg/L
24-APR-02	WEDNESDAY	COMP_CONDUCT	1020	Specific Conductance		1900	umhos/cm
24-APR-02	WEDNESDAY	COMP_PH	1020	pH		8.1	pH
24-APR-02	WEDNESDAY	GRAB	1030	Specific Conductance		2200	umhos/cm
24-APR-02	WEDNESDAY	GRAB	1030	pH		7.9	pH
24-APR-02	WEDNESDAY	GRAB_BNA	1030	1,2,4-trichlorobenzene	<	11.1	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	1,2-diphenylhydrazine	<	8.45	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	2,4,6-trichlorophenol	<	8.87	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	2,4-dimethylphenol	<	11	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	2,4-dinitrophenol	<	8.98	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	2,4-dinitrotoluene	<	6	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	2,4_dichlorophenol	<	9.32	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	2,6-dinitrotoluene	<	6.97	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	2-chloronaphthalene	<	7.64	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	2-chlorophenol	<	5	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	2-nitrophenol	<	9.22	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	3,3-dichlorobenzidine	<	9.99	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	4-bromophenyl phenyl ether	<	6.04	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	4-chloro-3-methylphenol	<	7.16	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	4-chlorophenyl phenyl ether	<	4.99	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	4-nitrophenol	<	4.9	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Acenaphthene	<	5.45	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Acenaphthylene	<	8.34	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Anthracene	<	7.16	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Benzidine	<	6.17	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Benzo(A)anthracene	<	5.2	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Benzo(A)pyrene	<	7.69	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Benzo(G,H,I)perylene	<	5.22	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Benzo(K)fluoranthene	<	7.9	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Benzo(b)fluoroanthene	<	6.98	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Bis-(2-ethylhexyl) phthalate		32	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Butyl benzyl phthalate	<	7.53	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Chrysene	<	4.04	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Di-n-Butyl phthalate	<	5.89	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Di-n-Octyl phthalate	<	9.17	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Dibenzo (A,H) Anthracene	<	7.66	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Diethyl Phthalate		12.6	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Dimethyl Phthalate	<	4.64	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Fluoranthene	<	4.68	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Fluorene	<	4.04	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Hexachlorobenzene	<	6.89	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Hexachlorobutadiene	<	9.17	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Hexachlorocyclopentadiene	<	8.87	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Hexachloroethane	<	5.27	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Isophorone	<	6	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	N-nitrosodi-n-propylamine	<	8.67	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	N-nitrosodimethylamine	<	5.4	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	N-nitrosodiphenylamine	<	5.01	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Naphthalene	<	7.47	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Nitrobenzene	<	7.92	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Pentachlorophenol	<	2.73	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Phenanthrene	<	4.76	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Phenol	<	2.43	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	Pyrene	<	4.86	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	bis(2-chloroethoxy)methane	<	10.4	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1030	bis(2-chloroethyl) ether	<	6.41	ug/L
24-APR-02	WEDNESDAY	GRAB_OG	1030	Hexane Extraction Method		113	mg/L
24-APR-02	WEDNESDAY	GRAB_OG	1030	SGT-HEM-Non Polar Material		13.7	mg/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Aldrin	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Alpha Endosulfan	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	BHC, Alpha	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	BHC, Beta	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	BHC, Delta	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	BHC, Gamma (Lindane)	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Beta Endosulfan	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Chlordane	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Chlorpyrifos		.44	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Demeton-O	<	.09	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Demeton-S	<	.05	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Diazinon		.27	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Dieldrin	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Endosulfan Sulfate	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Endrin	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Endrin aldehyde	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Guthion	<	.21	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Heptachlor	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Heptachlor epoxide	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Malathion	<	.04	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	PCB 1016	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	PCB 1221	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	PCB 1232	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	PCB 1242	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	PCB 1248	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	PCB 1254	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	PCB 1260	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	PCB-1262	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Parathion	<	.03	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	Toxaphene	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	p,p-DDD	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	p,p-DDE	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1030	p,p-DDT	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	1,1,1-trichloroethane	<	.78	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	1,1,2,2-tetrachloroethane	<	3.13	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	1,1,2-trichloroethane	<	3.02	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	1,1-dichloroethane	<	.71	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	1,1-dichloroethene	<	1.09	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	1,2-dichlorobenzene	<	1.37	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	1,2-dichloroethane	<	2.24	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	1,2-dichloropropane	<	.83	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	1,3-dichlorobenzene	<	1.31	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	1,4-dichlorobenzene		8.14	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	2-chloroethylvinyl ether	<	1.35	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Benzene	<	.81	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Bromodichloromethane	<	1.79	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Bromoform	<	3.58	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Bromomethane	<	1.39	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Carbon tetrachloride	<	1.92	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Chlorobenzene	<	1	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Chloroethane	<	.95	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Chloroform		3.22	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Chloromethane	<	3.23	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Dibromochloromethane	<	1.99	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Ethylbenzene	<	1.46	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Methylene chloride	<	1.29	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Tetrachloroethene		5.34	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Toluene		8.2	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Trichloroethene	<	1.32	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Trichlorofluoromethane	<	3.92	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	Vinyl chloride	<	1.04	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	cis-1,3-dichloropropene	<	1.01	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	trans-1,2-dichloroethene	<	.61	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1030	trans-1,3-dichloropropene	<	1.27	ug/L
01-MAY-02	WEDNESDAY	1_Hr_COMP	1100	Specific Conductance		1800	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1100	pH		7.6	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1200	Specific Conductance		1900	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1200	pH		7.6	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1300	Specific Conductance		1800	umhos/cm

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
01-MAY-02	WEDNESDAY	1_Hr_COMP	1300	pH		7.4	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1400	Specific Conductance		1700	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1400	pH		7.5	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1500	Specific Conductance		1700	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1500	pH		8.4	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1600	Specific Conductance		1900	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1600	pH		7.7	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1700	Specific Conductance		1800	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1700	pH		7.8	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1800	Specific Conductance		1700	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1800	pH		7.6	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1900	Specific Conductance		1800	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1900	pH		7.7	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	2000	Specific Conductance		1800	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	2000	pH		7.8	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	2100	Specific Conductance		1800	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	2100	pH		7.7	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	2200	Specific Conductance		1800	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	2200	pH		8	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	2300	Specific Conductance		1900	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	2300	pH		8.3	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	2400	Specific Conductance		1900	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	2400	pH		8	pH
02-MAY-02	THURSDAY	1_Hr_COMP	100	Specific Conductance		1800	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	100	pH		7.9	pH
02-MAY-02	THURSDAY	1_Hr_COMP	200	Specific Conductance		1800	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	200	pH		8.8	pH
02-MAY-02	THURSDAY	1_Hr_COMP	300	Specific Conductance		1700	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	300	pH		8	pH
02-MAY-02	THURSDAY	1_Hr_COMP	400	Specific Conductance		1700	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	400	pH		7.9	pH
02-MAY-02	THURSDAY	1_Hr_COMP	500	Specific Conductance		1700	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	500	pH		8.2	pH
02-MAY-02	THURSDAY	1_Hr_COMP	600	Specific Conductance		1500	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	600	pH		8	pH
02-MAY-02	THURSDAY	1_Hr_COMP	700	Specific Conductance		2200	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	700	pH		7.2	pH
02-MAY-02	THURSDAY	1_Hr_COMP	800	Specific Conductance		2700	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	800	pH		7.8	pH
02-MAY-02	THURSDAY	1_Hr_COMP	900	Specific Conductance		2100	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	900	pH		8.4	pH
02-MAY-02	THURSDAY	COMP_AUTO_BOD	950	Biochemical Oxygen Demand (BOD)		544	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_CN	950	Total Cyanide	<	.02	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_COD	950	Chemical Oxygen Demand		1070	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Aluminum		3.04	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Antimony	<	.015	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Arsenic		.004	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Barium		.175	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Beryllium	<	.006	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Cadmium	<	.009	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Chromium		.016	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Copper		.067	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Lead	<	.02	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Manganese		.048	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Mercury	<	.002	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Nickel		.013	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Selenium		.005	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Silver	<	.006	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Thallium	<	.001	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	950	Zinc		.38	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_MBAS	950	Methylene Blue Active Substances		18.1	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_NH3	950	Ammonia as (N)		37.3	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_SOLID	950	Total Suspended Solids		282	mg/L
02-MAY-02	THURSDAY	COMP_CONDUCT	950	Specific Conductance		1700	umhos/cm
02-MAY-02	THURSDAY	COMP_PH	950	pH		7.7	pH
02-MAY-02	THURSDAY	GRAB	1000	Specific Conductance		2300	umhos/cm
02-MAY-02	THURSDAY	GRAB	1000	pH		8.1	pH
02-MAY-02	THURSDAY	GRAB_BNA	1000	1,2,4-trichlorobenzene	<	11.1	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	1,2-diphenylhydrazine	<	8.45	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	2,4,6-trichlorophenol	<	8.87	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	2,4-dimethylphenol	<	11	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	2,4-dinitrophenol	<	8.98	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	2,4-dinitrotoluene	<	6	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	2,4_dichlorophenol	<	9.32	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	2,6-dinitrotoluene	<	6.97	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
02-MAY-02	THURSDAY	GRAB_BNA	1000	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	2-chloronaphthalene	<	7.64	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	2-chlorophenol	<	5	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	2-nitrophenol	<	9.22	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	3,3-dichlorobenzidine	<	9.99	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	4-bromophenyl phenyl ether	<	6.04	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	4-chloro-3-methylphenol	<	7.16	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	4-chlorophenyl phenyl ether	<	4.99	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	4-nitrophenol	<	4.9	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Acenaphthene	<	5.45	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Acenaphthylene	<	8.34	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Anthracene	<	7.16	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Benzidine	<	6.17	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Benzo(A)anthracene	<	5.2	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Benzo(A)pyrene	<	7.69	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Benzo(G,H,I)perylene	<	5.22	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Benzo(K)fluoranthene	<	7.9	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Benzo(b)fluoroanthene	<	6.98	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Bis-(2-ethylhexyl) phthalate		59.7	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Butyl benzyl phthalate	<	7.53	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Chrysene	<	4.04	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Di-n-Butyl phthalate	<	5.89	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Di-n-Octyl phthalate	<	9.17	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Dibenzo (A,H) Anthracene	<	7.66	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Diethyl Phthalate		24.9	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Dimethyl Phthalate	<	4.64	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Fluoranthene	<	4.68	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Fluorene	<	4.04	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Hexachlorobenzene	<	6.89	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Hexachlorobutadiene	<	9.17	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Hexachlorocyclopentadiene	<	8.87	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Hexachloroethane	<	5.27	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Isophorone	<	6	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	N-nitrosodi-n-propylamine	<	8.67	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	N-nitrosodimethylamine	<	5.4	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	N-nitrosodiphenylamine	<	5.01	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Naphthalene	<	7.47	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Nitrobenzene	<	7.92	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Pentachlorophenol	<	2.73	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Phenanthrene	<	4.76	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Phenol		128	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	Pyrene	<	4.86	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	bis(2-chloroethoxy)methane	<	10.4	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1000	bis(2-chloroethyl) ether	<	6.41	ug/L
02-MAY-02	THURSDAY	GRAB_OG	1000	Hexane Extraction Method		98.1	mg/L
02-MAY-02	THURSDAY	GRAB_OG	1000	SGT-HEM-Non Polar Material		11.9	mg/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	Aldrin	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	Alpha Endosulfan	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	BHC, Alpha	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	BHC, Beta	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	BHC, Delta	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	BHC, Gamma (Lindane)	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	Beta Endosulfan	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	Chlordane	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	Dieldrin	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	Endosulfan Sulfate	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	Endrin	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	Endrin aldehyde	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	Heptachlor	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	Heptachlor epoxide	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	PCB 1016	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	PCB 1221	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	PCB 1232	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	PCB 1242	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	PCB 1248	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	PCB 1254	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	PCB 1260	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	PCB-1262	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	Toxaphene	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	p,p-DDD	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	p,p-DDE	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1000	p,p-DDT	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	1,1,1-trichloroethane	<	.78	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
02-MAY-02	THURSDAY	GRAB_VOC	1000	1,1,2,2-tetrachloroethane	<	3.13	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	1,1,2-trichloroethane	<	3.02	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	1,1-dichloroethane	<	.71	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	1,1-dichloroethene	<	1.09	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	1,2-dichlorobenzene		2.21	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	1,2-dichloroethane	<	2.24	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	1,2-dichloropropane	<	.83	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	1,3-dichlorobenzene	<	1.31	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	1,4-dichlorobenzene		8.85	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	2-chloroethylvinyl ether	<	1.35	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Benzene	<	.81	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Bromodichloromethane	<	1.79	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Bromoform	<	3.58	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Bromomethane	<	1.39	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Carbon tetrachloride	<	1.92	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Chlorobenzene	<	1	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Chloroethane	<	.95	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Chloroform		3.16	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Chloromethane	<	3.23	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Dibromochloromethane	<	1.99	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Ethylbenzene	<	1.46	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Methylene chloride		3.63	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Tetrachloroethene		12.4	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Toluene		3.63	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Trichloroethene	<	1.32	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Trichlorofluoromethane	<	3.92	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	Vinyl chloride	<	1.04	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	cis-1,3-dichloropropene	<	1.01	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	trans-1,2-dichloroethene	<	.61	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1000	trans-1,3-dichloropropene	<	1.27	ug/L
09-MAY-02	THURSDAY	1_Hr_COMP	900	Specific Conductance		2300	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	900	pH		7.6	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1000	Specific Conductance		2200	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1000	pH		7.6	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1100	Specific Conductance		2300	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1100	pH		7.5	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1200	Specific Conductance		2300	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1200	pH		7.6	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1300	Specific Conductance		2100	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1300	pH		7.6	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1400	Specific Conductance		2100	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1400	pH		7.6	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1500	Specific Conductance		2100	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1500	pH		7.5	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1600	Specific Conductance		2100	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1600	pH		7.6	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1700	Specific Conductance		2100	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1700	pH		7.6	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1800	Specific Conductance		2100	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1800	pH		7.6	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1900	Specific Conductance		2000	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1900	pH		7.7	pH
09-MAY-02	THURSDAY	1_Hr_COMP	2000	Specific Conductance		1800	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	2000	pH		8.3	pH
09-MAY-02	THURSDAY	1_Hr_COMP	2100	Specific Conductance		2100	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	2100	pH		7.8	pH
09-MAY-02	THURSDAY	1_Hr_COMP	2200	pH		8.4	pH
09-MAY-02	THURSDAY	1_Hr_COMP	2300	Specific Conductance		2100	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	2300	pH		7.9	pH
09-MAY-02	THURSDAY	1_Hr_COMP	2400	Specific Conductance		2100	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	2400	pH		7.8	pH
10-MAY-02	FRIDAY	1_Hr_COMP	100	Specific Conductance		2000	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	100	pH		7.7	pH
10-MAY-02	FRIDAY	1_Hr_COMP	200	Specific Conductance		2000	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	200	pH		7.7	pH
10-MAY-02	FRIDAY	1_Hr_COMP	400	Specific Conductance		2000	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	400	pH		7.6	pH
10-MAY-02	FRIDAY	1_Hr_COMP	500	Specific Conductance		2000	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	500	pH		7.6	pH
10-MAY-02	FRIDAY	1_Hr_COMP	600	Specific Conductance		1900	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	600	pH		7.6	pH
10-MAY-02	FRIDAY	1_Hr_COMP	700	Specific Conductance		2100	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	700	pH		7.7	pH
10-MAY-02	FRIDAY	1_Hr_COMP	800	Specific Conductance		2200	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	800	pH		8.1	pH

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
10-MAY-02	FRIDAY	COMP_AUTO_BOD	945	Biochemical Oxygen Demand (BOD)		304	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_CN	945	Total Cyanide	<	.02	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_COD	945	Chemical Oxygen Demand		721	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Aluminum		2.08	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Antimony	<	.015	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Arsenic	<	.003	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Barium		.191	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Beryllium	<	.006	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Cadmium	<	.009	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Chromium		.013	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Copper		.078	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Lead	<	.02	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Manganese		.048	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Mercury	<	.002	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Nickel		.018	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Selenium	<	.003	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Silver		.009	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Thallium	<	.001	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	945	Zinc		.574	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_MBAS	945	Methylene Blue Active Substances		23.2	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_NH3	945	Ammonia as (N)		42.8	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_SOLID	945	Total Suspended Solids		194	mg/L
10-MAY-02	FRIDAY	COMP_CONDUCT	945	Specific Conductance		2200	umhos/cm
10-MAY-02	FRIDAY	COMP_PH	945	pH		7.5	pH
10-MAY-02	FRIDAY	GRAB	950	Specific Conductance		2300	umhos/cm
10-MAY-02	FRIDAY	GRAB	950	pH		7.9	pH
10-MAY-02	FRIDAY	GRAB_BNA	950	1,2,4-trichlorobenzene	<	11.1	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	1,2-diphenylhydrazine	<	8.45	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	2,4,6-trichlorophenol	<	8.87	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	2,4-dimethylphenol	<	11	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	2,4-dinitrophenol	<	8.98	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	2,4-dinitrotoluene	<	6	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	2,4_dichlorophenol	<	9.32	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	2,6-dinitrotoluene	<	6.97	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	2-chloronaphthalene	<	7.64	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	2-chlorophenol	<	5	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	2-nitrophenol	<	9.22	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	3,3-dichlorobenzidine	<	9.99	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	4-bromophenyl phenyl ether	<	6.04	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	4-chloro-3-methylphenol	<	7.16	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	4-chlorophenyl phenyl ether	<	4.99	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	4-nitrophenol	<	4.9	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Acenaphthene	<	5.45	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Acenaphthylene	<	8.34	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Anthracene	<	7.16	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Benzidine	<	6.17	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Benzo(A)anthracene	<	5.2	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Benzo(A)pyrene	<	7.69	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Benzo(G,H,I)perylene	<	5.22	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Benzo(K)fluoranthene	<	7.9	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Benzo(b)fluoroanthene	<	6.98	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Bis-(2-ethylhexyl) phthalate		36.6	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Butyl benzyl phthalate	<	7.53	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Chrysene	<	4.04	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Di-n-Butyl phthalate	<	5.89	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Di-n-Octyl phthalate	<	9.17	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Dibenzo (A,H) Anthracene	<	7.66	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Diethyl Phthalate		12.9	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Dimethyl Phthalate	<	4.64	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Fluoranthene	<	4.68	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Fluorene	<	4.04	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Hexachlorobenzene	<	6.89	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Hexachlorobutadiene	<	9.17	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Hexachlorocyclopentadiene	<	8.87	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Hexachloroethane	<	5.27	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Isophorone	<	6	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	N-nitrosodi-n-propylamine	<	8.67	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	N-nitrosodimethylamine	<	5.4	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	N-nitrosodiphenylamine	<	5.01	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Naphthalene	<	7.47	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Nitrobenzene	<	7.92	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Pentachlorophenol	<	2.73	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
10-MAY-02	FRIDAY	GRAB_BNA	950	Phenanthrene	<	4.76	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Phenol		70.8	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	Pyrene	<	4.86	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	bis(2-chloroethoxy)methane	<	10.4	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	950	bis(2-chloroethyl) ether	<	6.41	ug/L
10-MAY-02	FRIDAY	GRAB_OG	950	Hexane Extraction Method		98.8	mg/L
10-MAY-02	FRIDAY	GRAB_OG	950	SGT-HEM-Non Polar Material		7.35	mg/L
10-MAY-02	FRIDAY	GRAB_PEST	950	Aldrin	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	Alpha Endosulfan	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	BHC, Alpha	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	BHC, Beta	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	BHC, Delta	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	BHC, Gamma (Lindane)	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	Beta Endosulfan	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	Chlordane	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	Dieldrin	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	Endosulfan Sulfate	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	Endrin	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	Endrin aldehyde	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	Heptachlor	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	Heptachlor epoxide	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	PCB 1016	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	PCB 1221	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	PCB 1232	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	PCB 1242	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	PCB 1248	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	PCB 1254	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	PCB 1260	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	PCB-1262	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	Toxaphene	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	p,p-DDD	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	p,p-DDE	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	950	p,p-DDT	<	.1	ug/L
17-MAY-02	FRIDAY	1_Hr_COMP	815	Specific Conductance		1600	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	815	pH		7	pH
17-MAY-02	FRIDAY	1_Hr_COMP	915	Specific Conductance		1500	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	915	pH		7.4	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1015	Specific Conductance		1500	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1015	pH		7.5	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1115	Specific Conductance		1400	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1115	pH		7.5	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1215	Specific Conductance		1500	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1215	pH		7.5	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1315	Specific Conductance		1500	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1315	pH		7.4	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1415	Specific Conductance		1300	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1415	pH		7.4	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1515	Specific Conductance		1300	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1515	pH		7.4	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1615	Specific Conductance		1400	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1615	pH		7.4	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1715	Specific Conductance		1300	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1715	pH		7.4	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1815	Specific Conductance		1300	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1815	pH		7.4	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1915	Specific Conductance		1300	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1915	pH		7.4	pH
17-MAY-02	FRIDAY	1_Hr_COMP	2015	Specific Conductance		1300	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	2015	pH		7.4	pH
17-MAY-02	FRIDAY	1_Hr_COMP	2115	Specific Conductance		1300	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	2115	pH		7.4	pH
17-MAY-02	FRIDAY	1_Hr_COMP	2215	Specific Conductance		1300	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	2215	pH		7.4	pH
17-MAY-02	FRIDAY	1_Hr_COMP	2315	Specific Conductance		1300	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	2315	pH		7.4	pH
18-MAY-02	SATURDAY	1_Hr_COMP	15	Specific Conductance		1300	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	15	pH		7.4	pH
18-MAY-02	SATURDAY	1_Hr_COMP	115	Specific Conductance		1200	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	115	pH		7.5	pH
18-MAY-02	SATURDAY	1_Hr_COMP	215	Specific Conductance		1200	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	215	pH		7.5	pH
18-MAY-02	SATURDAY	1_Hr_COMP	315	Specific Conductance		1200	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	315	pH		7.5	pH
18-MAY-02	SATURDAY	1_Hr_COMP	415	Specific Conductance		1200	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	415	pH		7.5	pH

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
18-MAY-02	SATURDAY	1_Hr_COMP	515	Specific Conductance		1200	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	515	pH		7.5	pH
18-MAY-02	SATURDAY	1_Hr_COMP	615	Specific Conductance		1300	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	615	pH		7.4	pH
18-MAY-02	SATURDAY	1_Hr_COMP	715	Specific Conductance		1400	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	715	pH		7.4	pH
18-MAY-02	SATURDAY	COMP_AUTO_BOD	930	Biochemical Oxygen Demand (BOD)		247	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_CN	930	Total Cyanide	<	.02	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_COD	930	Chemical Oxygen Demand		845	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Aluminum		1.89	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Antimony	<	.015	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Arsenic		.003	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Barium		.287	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Beryllium	<	.006	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Cadmium	<	.009	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Chromium	<	.009	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Copper		.053	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Lead	<	.02	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Manganese		.036	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Mercury	<	.002	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Nickel		.021	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Selenium		.003	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Silver		.007	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Thallium	<	.001	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	930	Zinc		.325	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_NH3	930	Ammonia as (N)		41.6	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_SOLID	930	Total Suspended Solids		160	mg/L
18-MAY-02	SATURDAY	COMP_CONDUCT	930	Specific Conductance		1400	umhos/cm
18-MAY-02	SATURDAY	COMP_PH	930	pH		7	pH
18-MAY-02	SATURDAY	GRAB	935	Specific Conductance		1600	umhos/cm
18-MAY-02	SATURDAY	GRAB	935	pH		7.2	pH
18-MAY-02	SATURDAY	GRAB_BNA	935	1,2,4-trichlorobenzene	<	11.1	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	1,2-diphenylhydrazine	<	8.45	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	2,4,6-trichlorophenol	<	8.87	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	2,4-dimethylphenol	<	11	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	2,4-dinitrophenol	<	8.98	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	2,4-dinitrotoluene	<	6	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	2,4_dichlorophenol	<	9.32	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	2,6-dinitrotoluene	<	6.97	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	2-chloronaphthalene	<	7.64	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	2-chlorophenol	<	5	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	2-nitrophenol	<	9.22	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	3,3-dichlorobenzidine	<	9.99	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	4-bromophenyl phenyl ether	<	6.04	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	4-chloro-3-methylphenol	<	7.16	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	4-chlorophenyl phenyl ether	<	4.99	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	4-nitrophenol	<	4.9	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Acenaphthene	<	5.45	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Acenaphthylene	<	8.34	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Anthracene	<	7.16	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Benzidine	<	6.17	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Benzo(A)anthracene	<	5.2	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Benzo(A)pyrene	<	7.69	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Benzo(G,H,I)perylene	<	5.22	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Benzo(K)fluoranthene	<	7.9	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Benzo(b)fluoroanthene	<	6.98	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Bis-(2-ethylhexyl) phthalate		19.6	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Butyl benzyl phthalate	<	7.53	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Chrysene	<	4.04	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Di-n-Butyl phthalate	<	5.89	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Di-n-Octyl phthalate	<	9.17	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Dibenzo (A,H) Anthracene	<	7.66	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Diethyl Phthalate	<	4.66	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Dimethyl Phthalate	<	4.64	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Fluoranthene	<	4.68	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Fluorene	<	4.04	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Hexachlorobenzene	<	6.89	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Hexachlorobutadiene	<	9.17	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Hexachlorocyclopentadiene	<	8.87	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Hexachloroethane	<	5.27	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Isophorone	<	6	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	N-nitrosodi-n-propylamine	<	8.67	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
18-MAY-02	SATURDAY	GRAB_BNA	935	N-nitrosodimethylamine	<	5.4	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	N-nitrosodiphenylamine	<	5.01	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Naphthalene	<	7.47	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Nitrobenzene	<	7.92	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Pentachlorophenol	<	2.73	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Phenanthrene	<	4.76	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Phenol	<	2.43	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	Pyrene	<	4.86	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	bis(2-chloroethoxy)methane	<	10.4	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	935	bis(2-chloroethyl) ether	<	6.41	ug/L
18-MAY-02	SATURDAY	GRAB_OG	935	Hexane Extraction Method		63	mg/L
18-MAY-02	SATURDAY	GRAB_PEST	935	Aldrin	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	Alpha Endosulfan	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	BHC, Alpha	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	BHC, Beta	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	BHC, Delta	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	BHC, Gamma (Lindane)	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	Beta Endosulfan	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	Chlordane	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	Dieldrin	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	Endosulfan Sulfate	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	Endrin	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	Endrin aldehyde	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	Heptachlor	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	Heptachlor epoxide	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	PCB 1016	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	PCB 1221	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	PCB 1232	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	PCB 1242	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	PCB 1248	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	PCB 1254	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	PCB 1260	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	PCB-1262	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	Toxaphene	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	p,p-DDD	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	p,p-DDE	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	935	p,p-DDT	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	1,1,1-trichloroethane	<	.78	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	1,1,2,2-tetrachloroethane	<	3.13	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	1,1,2-trichloroethane	<	3.02	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	1,1-dichloroethane	<	.71	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	1,1-dichloroethene	<	1.09	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	1,2-dichlorobenzene	<	1.37	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	1,2-dichloroethane	<	2.24	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	1,2-dichloropropane	<	.83	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	1,3-dichlorobenzene	<	1.31	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	1,4-dichlorobenzene		6.91	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	2-chloroethylvinyl ether	<	1.35	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Benzene	<	.81	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Bromodichloromethane	<	1.79	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Bromoform	<	3.58	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Bromomethane	<	1.39	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Carbon tetrachloride	<	1.92	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Chlorobenzene	<	1	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Chloroethane	<	.95	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Chloroform	<	.57	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Chloromethane	<	3.23	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Dibromochloromethane	<	1.99	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Ethylbenzene	<	1.46	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Methylene chloride	<	1.29	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Tetrachloroethene		4	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Toluene		19.7	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Trichloroethene	<	1.32	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Trichlorofluoromethane	<	3.92	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	Vinyl chloride	<	1.04	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	cis-1,3-dichloropropene	<	1.01	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	trans-1,2-dichloroethene	<	.61	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	935	trans-1,3-dichloropropene	<	1.27	ug/L
25-MAY-02	SATURDAY	1_Hr_COMP	900	Specific Conductance		2300	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	900	pH		6.9	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1000	Specific Conductance		3600	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1000	pH		6.9	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1100	Specific Conductance		2400	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1100	pH		6.9	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1200	Specific Conductance		2200	umhos/cm

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
25-MAY-02	SATURDAY	1_Hr_COMP	1200	pH		6.9	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1300	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1300	pH		6.9	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1400	Specific Conductance		2300	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1400	pH		6.9	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1500	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1500	pH		6.9	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1600	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1600	pH		6.9	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1700	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1700	pH		6.9	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1800	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1800	pH		6.9	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1900	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1900	pH		6.9	pH
25-MAY-02	SATURDAY	1_Hr_COMP	2000	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	2000	pH		7	pH
25-MAY-02	SATURDAY	1_Hr_COMP	2100	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	2100	pH		7	pH
25-MAY-02	SATURDAY	1_Hr_COMP	2200	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	2200	pH		7	pH
25-MAY-02	SATURDAY	1_Hr_COMP	2300	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	2300	pH		7	pH
25-MAY-02	SATURDAY	1_Hr_COMP	2400	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	2400	pH		7	pH
26-MAY-02	SUNDAY	1_Hr_COMP	100	Specific Conductance		2200	umhos/cm
26-MAY-02	SUNDAY	1_Hr_COMP	100	pH		7.1	pH
26-MAY-02	SUNDAY	1_Hr_COMP	200	Specific Conductance		2200	umhos/cm
26-MAY-02	SUNDAY	1_Hr_COMP	200	pH		7.1	pH
26-MAY-02	SUNDAY	1_Hr_COMP	300	Specific Conductance		2200	umhos/cm
26-MAY-02	SUNDAY	1_Hr_COMP	300	pH		7.1	pH
26-MAY-02	SUNDAY	1_Hr_COMP	400	Specific Conductance		2200	umhos/cm
26-MAY-02	SUNDAY	1_Hr_COMP	400	pH		7.1	pH
26-MAY-02	SUNDAY	1_Hr_COMP	500	Specific Conductance		2200	umhos/cm
26-MAY-02	SUNDAY	1_Hr_COMP	500	pH		7.1	pH
26-MAY-02	SUNDAY	1_Hr_COMP	600	Specific Conductance		2200	umhos/cm
26-MAY-02	SUNDAY	1_Hr_COMP	600	pH		7.1	pH
26-MAY-02	SUNDAY	1_Hr_COMP	700	Specific Conductance		2200	umhos/cm
26-MAY-02	SUNDAY	1_Hr_COMP	700	pH		7.1	pH
26-MAY-02	SUNDAY	1_Hr_COMP	800	Specific Conductance		2200	umhos/cm
26-MAY-02	SUNDAY	1_Hr_COMP	800	pH		7.1	pH
26-MAY-02	SUNDAY	COMP_AUTO_BOD	1400	Biochemical Oxygen Demand (BOD)		342	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_CN	1400	Total Cyanide	<	.02	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_COD	1400	Chemical Oxygen Demand		1010	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Aluminum		1.94	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Antimony	<	.015	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Arsenic	<	.003	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Barium		.527	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Beryllium	<	.006	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Cadmium	<	.009	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Chromium		.034	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Copper		.095	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Lead	<	.02	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Manganese		.049	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Mercury		.0026	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Nickel		.054	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Selenium		.005	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Silver	<	.006	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Thallium	<	.001	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1400	Zinc		.676	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_NH3	1400	Ammonia as (N)		48.8	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_SOLID	1400	Total Suspended Solids		210	mg/L
26-MAY-02	SUNDAY	COMP_CONDUCT	1400	Specific Conductance		2300	umhos/cm
26-MAY-02	SUNDAY	COMP_PH	1400	pH		7.1	pH
26-MAY-02	SUNDAY	GRAB	1410	Specific Conductance		2300	umhos/cm
26-MAY-02	SUNDAY	GRAB	1410	pH		7.9	pH
26-MAY-02	SUNDAY	GRAB_BNA	1410	1,2,4-trichlorobenzene	<	11.1	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	1,2-diphenylhydrazine	<	8.45	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	2,4,6-trichlorophenol	<	8.87	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	2,4-dimethylphenol	<	11	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	2,4-dinitrophenol	<	8.98	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	2,4-dinitrotoluene	<	6	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	2,4_dichlorophenol	<	9.32	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	2,6-dinitrotoluene	<	6.97	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
26-MAY-02	SUNDAY	GRAB_BNA	1410	2-chloronaphthalene	<	7.64	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	2-chlorophenol	<	5	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	2-nitrophenol	<	9.22	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	3,3-dichlorobenzidine	<	9.99	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	4-bromophenyl phenyl ether	<	6.04	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	4-chloro-3-methylphenol	<	7.16	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	4-chlorophenyl phenyl ether	<	4.99	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	4-nitrophenol	<	4.9	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Acenaphthene	<	5.45	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Acenaphthylene	<	8.34	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Anthracene	<	7.16	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Benzidine	<	6.17	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Benzo(A)anthracene	<	5.2	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Benzo(A)pyrene	<	7.69	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Benzo(G,H,I)perylene	<	5.22	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Benzo(K)fluoranthene	<	7.9	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Benzo(b)fluoroanthene	<	6.98	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Bis-(2-ethylhexyl) phthalate		73.2	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Butyl benzyl phthalate	<	7.53	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Chrysene	<	4.04	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Di-n-Butyl phthalate		7.34	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Di-n-Octyl phthalate	<	9.17	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Dibenzo (A,H) Anthracene	<	7.66	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Diethyl Phthalate		23.9	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Dimethyl Phthalate	<	4.64	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Fluoranthene	<	4.68	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Fluorene	<	4.04	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Hexachlorobenzene	<	6.89	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Hexachlorobutadiene	<	9.17	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Hexachlorocyclopentadiene	<	8.87	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Hexachloroethane	<	5.27	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Isophorone	<	6	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	N-nitrosodi-n-propylamine	<	8.67	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	N-nitrosodimethylamine	<	5.4	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	N-nitrosodiphenylamine	<	5.01	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Naphthalene	<	7.47	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Nitrobenzene	<	7.92	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Pentachlorophenol	<	2.73	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Phenanthrene	<	4.76	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Phenol		8.67	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	Pyrene	<	4.86	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	bis(2-chloroethoxy)methane	<	10.4	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1410	bis(2-chloroethyl) ether	<	6.41	ug/L
26-MAY-02	SUNDAY	GRAB_OG	1410	Hexane Extraction Method		75	mg/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	Aldrin	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	Alpha Endosulfan	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	BHC, Alpha	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	BHC, Beta	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	BHC, Delta	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	BHC, Gamma (Lindane)	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	Beta Endosulfan	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	Chlordane	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	Dieldrin	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	Endosulfan Sulfate	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	Endrin	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	Endrin aldehyde	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	Heptachlor	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	Heptachlor epoxide	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	PCB 1016	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	PCB 1221	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	PCB 1232	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	PCB 1242	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	PCB 1248	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	PCB 1254	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	PCB 1260	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	PCB-1262	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	Toxaphene	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	p,p-DDD	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	p,p-DDE	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1410	p,p-DDT	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	1,1,1-trichloroethane	<	.78	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	1,1,2,2-tetrachloroethane	<	3.13	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	1,1,2-trichloroethane	<	3.02	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
26-MAY-02	SUNDAY	GRAB_VOC	1410	1,1-dichloroethane	<	.71	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	1,1-dichloroethene	<	1.09	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	1,2-dichlorobenzene	<	1.37	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	1,2-dichloroethane	<	2.24	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	1,2-dichloropropane	<	.83	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	1,3-dichlorobenzene	<	1.31	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	1,4-dichlorobenzene		7.95	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	2-chloroethylvinyl ether	<	1.35	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Benzene	<	.81	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Bromodichloromethane	<	1.79	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Bromoform	<	3.58	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Bromomethane	<	1.39	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Carbon tetrachloride	<	1.92	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Chlorobenzene	<	1	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Chloroethane	<	.95	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Chloroform		3.55	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Chloromethane	<	3.23	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Dibromochloromethane		3.53	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Ethylbenzene	<	1.46	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Methylene chloride		2.33	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Tetrachloroethene		5.42	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Toluene		4.59	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Trichloroethene	<	1.32	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Trichlorofluoromethane	<	3.92	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	Vinyl chloride	<	1.04	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	cis-1,3-dichloropropene	<	1.01	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	trans-1,2-dichloroethene	<	.61	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1410	trans-1,3-dichloropropene	<	1.27	ug/L

SITE 2

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
26-FEB-02	TUESDAY	1_Hr_COMP	1330	Specific Conductance		1700	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1330	pH		7.6	pH
26-FEB-02	TUESDAY	1_Hr_COMP	1430	Specific Conductance		1800	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1430	pH		7.5	pH
26-FEB-02	TUESDAY	1_Hr_COMP	1530	Specific Conductance		1800	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1530	pH		7.6	pH
26-FEB-02	TUESDAY	1_Hr_COMP	1630	Specific Conductance		1900	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1630	pH		7.5	pH
26-FEB-02	TUESDAY	1_Hr_COMP	1730	Specific Conductance		1900	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1730	pH		7.4	pH
26-FEB-02	TUESDAY	1_Hr_COMP	1830	Specific Conductance		1900	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1830	pH		7.4	pH
26-FEB-02	TUESDAY	1_Hr_COMP	1930	Specific Conductance		1900	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	1930	pH		7.4	pH
26-FEB-02	TUESDAY	1_Hr_COMP	2030	Specific Conductance		1900	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	2030	pH		7.3	pH
26-FEB-02	TUESDAY	1_Hr_COMP	2130	Specific Conductance		1900	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	2130	pH		7.3	pH
26-FEB-02	TUESDAY	1_Hr_COMP	2230	Specific Conductance		2000	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	2230	pH		7.4	pH
26-FEB-02	TUESDAY	1_Hr_COMP	2330	Specific Conductance		2000	umhos/cm
26-FEB-02	TUESDAY	1_Hr_COMP	2330	pH		7.3	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	30	Specific Conductance		2000	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	30	pH		7.4	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	130	Specific Conductance		2200	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	130	pH		7.4	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	230	Specific Conductance		2000	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	230	pH		7.4	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	330	Specific Conductance		2100	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	330	pH		7.5	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	430	Specific Conductance		2100	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	430	pH		7.5	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	530	Specific Conductance		2100	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	530	pH		7.5	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	630	Specific Conductance		2100	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	630	pH		7.5	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	730	Specific Conductance		2100	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	730	pH		7.6	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	830	Specific Conductance		2100	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	830	pH		7.6	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	930	Specific Conductance		2100	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	930	pH		7.6	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	1030	Specific Conductance		2200	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	1030	pH		7.6	pH
27-FEB-02	WEDNESDAY	1_Hr_COMP	1130	Specific Conductance		2200	umhos/cm
27-FEB-02	WEDNESDAY	1_Hr_COMP	1130	pH		7.6	pH
27-FEB-02	WEDNESDAY	COMP_AUTO_CN	1235	Total Cyanide	<	.02	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_COD	1235	Chemical Oxygen Demand		466	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Aluminum		1.89	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Antimony	<	.015	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Arsenic	<	.003	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Barium		.144	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Beryllium	<	.006	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Cadmium	<	.009	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Chromium		.123	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Copper		.099	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Lead		.02	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Manganese		.054	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Mercury	<	.002	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Nickel		.139	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Selenium	<	.003	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Silver	<	.006	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Thallium	<	.001	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_HM	1235	Zinc		.373	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_MBAS	1235	Methylene Blue Active Substances		20.5	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_NH3	1235	Ammonia as (N)		52	mg/L
27-FEB-02	WEDNESDAY	COMP_AUTO_SOLID	1235	Total Suspended Solids		124	mg/L
27-FEB-02	WEDNESDAY	COMP_CONDUCT	1235	Specific Conductance		1900	umhos/cm
27-FEB-02	WEDNESDAY	COMP_PH	1235	pH		7.5	pH
27-FEB-02	WEDNESDAY	GRAB	1245	Specific Conductance		2000	umhos/cm
27-FEB-02	WEDNESDAY	GRAB	1245	pH		7.3	pH
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	1,2,4-trichlorobenzene	<	11.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	1,2-diphenylhydrazine	<	8.45	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	2,4,6-trichlorophenol	<	8.87	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	2,4-dimethylphenol	<	11	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	2,4-dinitrophenol	<	8.98	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	2,4-dinitrotoluene	<	6	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	2,4_dichlorophenol	<	9.32	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	2,6-dinitrotoluene	<	6.97	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	2-chloronaphthalene	<	7.64	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	2-chlorophenol	<	5	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	2-nitrophenol	<	9.22	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	3,3-dichlorobenzidine	<	9.99	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	4-bromophenyl phenyl ether	<	6.04	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	4-chloro-3-methylphenol	<	7.16	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	4-chlorophenyl phenyl ether	<	4.99	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	4-nitrophenol	<	4.9	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Acenaphthene	<	5.45	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Acenaphthylene	<	8.34	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Anthracene	<	7.16	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Benzidine	<	6.17	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Benzo(A)anthracene	<	5.2	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Benzo(A)pyrene	<	7.69	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Benzo(G,H,I)perylene	<	5.22	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Benzo(K)fluoranthene	<	7.9	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Benzo(b)fluoroanthene	<	6.98	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Bis-(2-ethylhexyl) phthalate		21.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Butyl benzyl phthalate	<	7.53	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Chrysene	<	4.04	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Di-n-Butyl phthalate	<	5.89	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Di-n-Octyl phthalate	<	9.17	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Dibenzo (A,H) Anthracene	<	7.66	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Diethyl Phthalate		7.8	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Dimethyl Phthalate	<	4.64	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Fluoranthene	<	4.68	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Fluorene	<	4.04	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Hexachlorobenzene	<	6.89	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Hexachlorobutadiene	<	9.17	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Hexachlorocyclopentadiene	<	8.87	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Hexachloroethane	<	5.27	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Isophorone	<	6	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	N-nitrosodi-n-propylamine	<	8.67	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	N-nitrosodimethylamine	<	5.4	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	N-nitrosodiphenylamine	<	5.01	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Naphthalene	<	7.47	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Nitrobenzene	<	7.92	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Pentachlorophenol	<	2.73	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Phenanthrene	<	4.76	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Phenol		12.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	Pyrene	<	4.86	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	bis(2-chloroethoxy)methane	<	10.4	ug/L
27-FEB-02	WEDNESDAY	GRAB_BNA	1245	bis(2-chloroethyl) ether	<	6.41	ug/L
27-FEB-02	WEDNESDAY	GRAB_OG	1245	Hexane Extraction Method		25.2	mg/L
27-FEB-02	WEDNESDAY	GRAB_OG	1245	SGT-HEM-Non Polar Material	<	5	mg/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Aldrin	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Alpha Endosulfan	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	BHC, Alpha	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	BHC, Beta	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	BHC, Delta	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	BHC, Gamma (Lindane)	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Beta Endosulfan	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Chlordane	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Chlorpyrifos	<	.05	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Demeton-O	<	.09	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Demeton-S	<	.05	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Diazinon		.077	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Dieldrin	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Endosulfan Sulfate	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Endrin	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Endrin aldehyde	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Guthion	<	.21	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Heptachlor	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Heptachlor epoxide	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Malathion		.23	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	PCB 1016	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	PCB 1221	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	PCB 1232	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	PCB 1242	<	.5	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	PCB 1248	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	PCB 1254	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	PCB 1260	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	PCB-1262	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Parathion	<	.03	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	Toxaphene	<	.5	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	p,p-DDD	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	p,p-DDE	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_PEST	1245	p,p-DDT	<	.1	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	1,1,1-trichloroethane	<	.78	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	1,1,2,2-tetrachloroethane	<	3.13	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	1,1,2-trichloroethane	<	3.02	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	1,1-dichloroethane	<	.71	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	1,1-dichloroethene	<	1.09	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	1,2-dichlorobenzene	<	1.37	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	1,2-dichloroethane	<	2.24	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	1,2-dichloropropane	<	.83	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	1,3-dichlorobenzene	<	1.31	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	1,4-dichlorobenzene		1.37	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	2-chloroethylvinyl ether	<	1.35	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Benzene	<	.92	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Bromodichloromethane	<	1.79	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Bromoform	<	3.58	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Bromomethane	<	1.39	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Carbon tetrachloride	<	1.92	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Chlorobenzene	<	1	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Chloroethane	<	.95	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Chloroform		8.02	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Chloromethane	<	3.23	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Dibromochloromethane	<	1.99	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Ethylbenzene	<	1.46	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Methylene chloride		1.91	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Tetrachloroethene	<	1.04	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Toluene		14.3	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Trichloroethene	<	1.32	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Trichlorofluoromethane	<	3.92	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	Vinyl chloride	<	1.04	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	cis-1,3-dichloropropene	<	1.01	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	trans-1,2-dichloroethene	<	.61	ug/L
27-FEB-02	WEDNESDAY	GRAB_VOC	1245	trans-1,3-dichloropropene	<	1.27	ug/L
06-MAR-02	WEDNESDAY	1_Hr_COMP	1035	Specific Conductance		1800	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1035	pH		7.7	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1135	Specific Conductance		1800	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1135	pH		7.8	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1235	Specific Conductance		1900	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1235	pH		7.7	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1335	Specific Conductance		2000	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1335	pH		7.7	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1435	Specific Conductance		2000	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1435	pH		7.7	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1535	Specific Conductance		2000	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1535	pH		7.8	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1635	Specific Conductance		1900	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1635	pH		7.8	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1735	Specific Conductance		2000	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1735	pH		7.8	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1835	Specific Conductance		2000	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1835	pH		7.8	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	1935	Specific Conductance		2000	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	1935	pH		7.8	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	2035	Specific Conductance		2100	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	2035	pH		7.8	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	2135	Specific Conductance		2100	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	2135	pH		7.7	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	2235	Specific Conductance		2100	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	2235	pH		7.8	pH
06-MAR-02	WEDNESDAY	1_Hr_COMP	2335	Specific Conductance		2100	umhos/cm
06-MAR-02	WEDNESDAY	1_Hr_COMP	2335	pH		7.8	pH
07-MAR-02	THURSDAY	1_Hr_COMP	35	Specific Conductance		2100	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	35	pH		7.7	pH
07-MAR-02	THURSDAY	1_Hr_COMP	135	Specific Conductance		2100	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	135	pH		7.7	pH
07-MAR-02	THURSDAY	1_Hr_COMP	235	Specific Conductance		2200	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	235	pH		7.6	pH
07-MAR-02	THURSDAY	1_Hr_COMP	335	Specific Conductance		2100	umhos/cm

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
07-MAR-02	THURSDAY	1_Hr_COMP	335	pH		7.6	pH
07-MAR-02	THURSDAY	1_Hr_COMP	435	Specific Conductance		2100	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	435	pH		7.6	pH
07-MAR-02	THURSDAY	1_Hr_COMP	535	Specific Conductance		2100	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	535	pH		7.5	pH
07-MAR-02	THURSDAY	1_Hr_COMP	635	Specific Conductance		2100	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	635	pH		7.6	pH
07-MAR-02	THURSDAY	1_Hr_COMP	735	Specific Conductance		2100	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	735	pH		7.6	pH
07-MAR-02	THURSDAY	1_Hr_COMP	835	Specific Conductance		2100	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	835	pH		7.5	pH
07-MAR-02	THURSDAY	1_Hr_COMP	935	Specific Conductance		2100	umhos/cm
07-MAR-02	THURSDAY	1_Hr_COMP	935	pH		7.6	pH
07-MAR-02	THURSDAY	COMP_AUTO_BOD	1030	Biochemical Oxygen Demand (BOD)		135	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_CN	1030	Total Cyanide	<	.02	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_COD	1030	Chemical Oxygen Demand		443	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Aluminum		1.3	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Antimony	<	.015	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Arsenic	<	.003	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Barium		.541	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Cadmium	<	.009	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Chromium		.088	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Copper		.068	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Lead	<	.02	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Manganese		.043	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Mercury	<	.002	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Nickel		.085	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Selenium	<	.003	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Silver	<	.006	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Thallium	<	.001	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_HM	1030	Zinc		.625	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_MBAS	1030	Methylene Blue Active Substances		18.9	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_NH3	1030	Ammonia as (N)		50.8	mg/L
07-MAR-02	THURSDAY	COMP_AUTO_SOLID	1030	Total Suspended Solids		114	mg/L
07-MAR-02	THURSDAY	COMP_CONDUCT	1030	Specific Conductance		1900	umhos/cm
07-MAR-02	THURSDAY	COMP_PH	1030	pH		7.7	pH
07-MAR-02	THURSDAY	GRAB	1040	Specific Conductance		2100	umhos/cm
07-MAR-02	THURSDAY	GRAB	1040	pH		7.3	pH
07-MAR-02	THURSDAY	GRAB_BNA	1040	1,2,4-trichlorobenzene	<	11.1	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	1,2-diphenylhydrazine	<	8.45	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	2,4,6-trichlorophenol	<	8.87	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	2,4-dimethylphenol	<	11	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	2,4-dinitrophenol	<	8.98	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	2,4-dinitrotoluene	<	6	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	2,4_dichlorophenol	<	9.32	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	2,6-dinitrotoluene	<	6.97	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	2-chloronaphthalene	<	7.64	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	2-chlorophenol	<	5	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	2-nitrophenol	<	9.22	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	3,3-dichlorobenzidine	<	9.99	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	4-bromophenyl phenyl ether	<	6.04	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	4-chloro-3-methylphenol	<	7.16	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	4-chlorophenyl phenyl ether	<	4.99	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	4-nitrophenol	<	4.9	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Acenaphthene	<	5.45	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Acenaphthylene	<	8.34	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Anthracene	<	7.16	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Benzidine	<	6.17	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Benzo(A)anthracene	<	5.2	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Benzo(A)pyrene	<	7.69	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Benzo(G,H,I)perylene	<	5.22	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Benzo(K)fluoranthene	<	7.9	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Benzo(b)fluoroanthene	<	6.98	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Bis-(2-ethylhexyl) phthalate		35.7	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Butyl benzyl phthalate	<	7.53	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Chrysene	<	4.04	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Di-n-Butyl phthalate	<	5.89	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Di-n-Octyl phthalate	<	9.17	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Dibenzo (A,H) Anthracene	<	7.66	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Diethyl Phthalate		9.69	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Dimethyl Phthalate	<	4.64	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Fluoranthene	<	4.68	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Fluorene	<	4.04	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
07-MAR-02	THURSDAY	GRAB_BNA	1040	Hexachlorobenzene	<	6.89	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Hexachlorobutadiene	<	9.17	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Hexachlorocyclopentadiene	<	8.87	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Hexachloroethane	<	5.27	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Isophorone	<	6	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	N-nitrosodi-n-propylamine	<	8.67	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	N-nitrosodimethylamine	<	5.4	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	N-nitrosodiphenylamine	<	5.01	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Naphthalene	<	7.47	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Nitrobenzene	<	7.92	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Pentachlorophenol	<	2.73	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Phenanthrene	<	4.76	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Phenol	<	2.43	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	Pyrene	<	4.86	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	bis(2-chloroethoxy)methane	<	10.4	ug/L
07-MAR-02	THURSDAY	GRAB_BNA	1040	bis(2-chloroethyl) ether	<	6.41	ug/L
07-MAR-02	THURSDAY	GRAB_OG	1040	Hexane Extraction Method		26.3	mg/L
07-MAR-02	THURSDAY	GRAB_OG	1040	SGT-HEM-Non Polar Material		6.5	mg/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	Aldrin	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	Alpha Endosulfan	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	BHC, Alpha	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	BHC, Beta	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	BHC, Delta	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	BHC, Gamma (Lindane)	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	Beta Endosulfan	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	Chlordane	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	Dieldrin	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	Endosulfan Sulfate	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	Endrin	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	Endrin aldehyde	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	Heptachlor	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	Heptachlor epoxide	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	PCB 1016	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	PCB 1221	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	PCB 1232	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	PCB 1242	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	PCB 1248	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	PCB 1254	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	PCB 1260	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	PCB-1262	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	Toxaphene	<	.5	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	p,p-DDD	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	p,p-DDE	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_PEST	1040	p,p-DDT	<	.1	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	1,1,1-trichloroethane	<	.78	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	1,1,2,2-tetrachloroethane	<	3.13	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	1,1,2-trichloroethane	<	3.02	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	1,1-dichloroethane	<	.71	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	1,1-dichloroethene	<	1.09	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	1,2-dichlorobenzene	<	1.37	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	1,2-dichloroethane	<	2.24	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	1,2-dichloropropane	<	.83	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	1,3-dichlorobenzene	<	1.31	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	1,4-dichlorobenzene		1.9	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	2-chloroethylvinyl ether	<	1.35	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Benzene	<	.92	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Bromodichloromethane	<	1.79	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Bromoform	<	3.58	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Bromomethane	<	1.39	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Carbon tetrachloride	<	1.92	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Chlorobenzene	<	1	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Chloroethane	<	.95	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Chloroform		3.08	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Chloromethane	<	3.23	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Dibromochloromethane	<	1.99	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Ethylbenzene	<	1.46	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Methylene chloride	<	1.29	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Tetrachloroethene	<	1.04	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Toluene		17.2	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Trichloroethene	<	1.32	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Trichlorofluoromethane	<	3.92	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	Vinyl chloride	<	1.04	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	cis-1,3-dichloropropene	<	1.01	ug/L
07-MAR-02	THURSDAY	GRAB_VOC	1040	trans-1,2-dichloroethene	<	.61	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
07-MAR-02	THURSDAY	GRAB_VOC	1040	trans-1,3-dichloropropene	<	1.27	ug/L
14-MAR-02	THURSDAY	1_Hr_COMP	910	Specific Conductance		1800	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	910	pH		7.5	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1010	Specific Conductance		1800	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1010	pH		7.5	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1110	Specific Conductance		1800	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1110	pH		7.6	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1210	Specific Conductance		1900	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1210	pH		7.7	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1310	Specific Conductance		1900	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1310	pH		7.7	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1410	Specific Conductance		2000	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1410	pH		7.7	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1510	Specific Conductance		2000	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1510	pH		7.7	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1610	Specific Conductance		2000	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1610	pH		7.7	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1710	Specific Conductance		2000	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1710	pH		7.7	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1810	Specific Conductance		2100	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1810	pH		7.7	pH
14-MAR-02	THURSDAY	1_Hr_COMP	1910	Specific Conductance		2100	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	1910	pH		7.7	pH
14-MAR-02	THURSDAY	1_Hr_COMP	2010	Specific Conductance		2100	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	2010	pH		7.7	pH
14-MAR-02	THURSDAY	1_Hr_COMP	2110	Specific Conductance		2100	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	2110	pH		7.7	pH
14-MAR-02	THURSDAY	1_Hr_COMP	2210	Specific Conductance		2100	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	2210	pH		7.6	pH
14-MAR-02	THURSDAY	1_Hr_COMP	2310	Specific Conductance		2100	umhos/cm
14-MAR-02	THURSDAY	1_Hr_COMP	2310	pH		7.6	pH
15-MAR-02	FRIDAY	1_Hr_COMP	10	Specific Conductance		2100	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	10	pH		7.6	pH
15-MAR-02	FRIDAY	1_Hr_COMP	110	Specific Conductance		2100	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	110	pH		7.6	pH
15-MAR-02	FRIDAY	1_Hr_COMP	210	Specific Conductance		2100	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	210	pH		7.5	pH
15-MAR-02	FRIDAY	1_Hr_COMP	310	Specific Conductance		2200	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	310	pH		7.5	pH
15-MAR-02	FRIDAY	1_Hr_COMP	410	Specific Conductance		2100	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	410	pH		7.4	pH
15-MAR-02	FRIDAY	1_Hr_COMP	510	Specific Conductance		2100	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	510	pH		7.4	pH
15-MAR-02	FRIDAY	1_Hr_COMP	610	Specific Conductance		2100	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	610	pH		7.4	pH
15-MAR-02	FRIDAY	1_Hr_COMP	710	Specific Conductance		2100	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	710	pH		7.4	pH
15-MAR-02	FRIDAY	1_Hr_COMP	810	Specific Conductance		2100	umhos/cm
15-MAR-02	FRIDAY	1_Hr_COMP	810	pH		7.5	pH
15-MAR-02	FRIDAY	COMP_AUTO_BOD	1000	Biochemical Oxygen Demand (BOD)		295	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_CN	1000	Total Cyanide	<	.02	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_COD	1000	Chemical Oxygen Demand		511	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Aluminum		1.79	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Antimony	<	.015	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Arsenic	<	.003	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Barium		.242	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Beryllium	<	.006	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Cadmium	<	.009	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Chromium		.116	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Copper		.083	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Lead	<	.02	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Manganese		.048	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Mercury	<	.002	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Nickel		.111	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Selenium		.003	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Silver	<	.006	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Thallium		.001	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_HM	1000	Zinc		.559	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_MBAS	1000	Methylene Blue Active Substances		20.8	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_NH3	1000	Ammonia as (N)		50.4	mg/L
15-MAR-02	FRIDAY	COMP_AUTO_SOLID	1000	Total Suspended Solids		124	mg/L
15-MAR-02	FRIDAY	COMP_CONDUCT	1000	Specific Conductance		1900	umhos/cm
15-MAR-02	FRIDAY	COMP_PH	1000	pH		7.5	pH
15-MAR-02	FRIDAY	GRAB	1020	Specific Conductance		1900	umhos/cm
15-MAR-02	FRIDAY	GRAB	1020	pH		7.4	pH

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
15-MAR-02	FRIDAY	GRAB_BNA	1020	1,2,4-trichlorobenzene	<	11.1	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	1,2-diphenylhydrazine	<	8.45	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	2,4,6-trichlorophenol	<	8.87	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	2,4-dimethylphenol	<	11	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	2,4-dinitrophenol	<	8.98	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	2,4-dinitrotoluene	<	6	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	2,4_dichlorophenol	<	9.32	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	2,6-dinitrotoluene	<	6.97	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	2-chloronaphthalene	<	7.64	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	2-chlorophenol	<	5	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	2-nitrophenol	<	9.22	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	3,3-dichlorobenzidine	<	9.99	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	4-bromophenyl phenyl ether	<	6.04	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	4-chloro-3-methylphenol	<	7.16	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	4-chlorophenyl phenyl ether	<	4.99	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	4-nitrophenol	<	4.9	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Acenaphthene	<	5.45	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Acenaphthylene	<	8.34	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Anthracene	<	7.16	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Benzidine	<	6.17	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Benzo(A)anthracene	<	5.2	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Benzo(A)pyrene	<	7.69	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Benzo(G,H,I)perylene	<	5.22	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Benzo(K)fluoranthene	<	7.9	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Benzo(b)fluoroanthene	<	6.98	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Bis-(2-ethylhexyl) phthalate		28	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Butyl benzyl phthalate	<	7.53	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Chrysene	<	4.04	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Di-n-Butyl phthalate	<	5.89	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Di-n-Octyl phthalate	<	9.17	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Dibenzo (A,H) Anthracene	<	7.66	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Diethyl Phthalate		7.19	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Dimethyl Phthalate	<	4.64	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Fluoranthene	<	4.68	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Fluorene	<	4.04	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Hexachlorobenzene	<	6.89	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Hexachlorobutadiene	<	9.17	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Hexachlorocyclopentadiene	<	8.87	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Hexachloroethane	<	5.27	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Isophorone	<	6	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	N-nitrosodi-n-propylamine	<	8.67	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	N-nitrosodimethylamine	<	5.4	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	N-nitrosodiphenylamine	<	5.01	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Naphthalene	<	7.47	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Nitrobenzene	<	7.92	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Pentachlorophenol	<	2.73	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Phenanthrene	<	4.76	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Phenol		6.04	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	Pyrene	<	4.86	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	bis(2-chloroethoxy)methane	<	10.4	ug/L
15-MAR-02	FRIDAY	GRAB_BNA	1020	bis(2-chloroethyl) ether	<	6.41	ug/L
15-MAR-02	FRIDAY	GRAB_OG	1020	Hexane Extraction Method		23.8	mg/L
15-MAR-02	FRIDAY	GRAB_OG	1020	SGT-HEM-Non Polar Material	<	5	mg/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Aldrin	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Alpha Endosulfan	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	BHC, Alpha	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	BHC, Beta	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	BHC, Delta	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	BHC, Gamma (Lindane)	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Beta Endosulfan	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Chlordane	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Chlorpyrifos		.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Demeton-O	<	.09	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Demeton-S	<	.05	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Diazinon		.092	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Dieldrin	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Endosulfan Sulfate	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Endrin	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Endrin aldehyde	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Guthion	<	.21	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Heptachlor	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Heptachlor epoxide	<	.1	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
15-MAR-02	FRIDAY	GRAB_PEST	1020	Malathion		.058	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	PCB 1016	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	PCB 1221	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	PCB 1232	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	PCB 1242	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	PCB 1248	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	PCB 1254	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	PCB 1260	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	PCB-1262	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Parathion	<	.03	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	Toxaphene	<	.5	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	p,p-DDD	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	p,p-DDE	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_PEST	1020	p,p-DDT	<	.1	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	1,1,1-trichloroethane	<	.78	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	1,1,2,2-tetrachloroethane	<	3.13	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	1,1,2-trichloroethane	<	3.02	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	1,1-dichloroethane	<	.71	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	1,1-dichloroethene	<	1.09	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	1,2-dichlorobenzene	<	1.37	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	1,2-dichloroethane	<	2.24	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	1,2-dichloropropane	<	.83	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	1,3-dichlorobenzene	<	1.31	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	1,4-dichlorobenzene		1.49	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	2-chloroethylvinyl ether	<	1.35	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Benzene	<	.92	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Bromodichloromethane	<	1.79	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Bromoform	<	3.58	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Bromomethane	<	1.39	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Carbon tetrachloride	<	1.92	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Chlorobenzene	<	1	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Chloroethane	<	.95	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Chloroform		1.73	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Chloromethane	<	3.23	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Dibromochloromethane	<	1.99	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Ethylbenzene	<	1.46	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Methylene chloride	<	1.29	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Tetrachloroethene	<	1.04	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Toluene		13.4	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Trichloroethene	<	1.32	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Trichlorofluoromethane	<	3.92	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	Vinyl chloride	<	1.04	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	cis-1,3-dichloropropene	<	1.01	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	trans-1,2-dichloroethene	<	.61	ug/L
15-MAR-02	FRIDAY	GRAB_VOC	1020	trans-1,3-dichloropropene	<	1.27	ug/L
22-MAR-02	FRIDAY	1_Hr_COMP	915	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	915	pH		6.3	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1015	Specific Conductance		2000	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1015	pH		6.3	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1115	Specific Conductance		2000	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1115	pH		6.3	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1215	Specific Conductance		2000	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1215	pH		6.3	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1315	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1315	pH		6.2	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1415	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1415	pH		6.2	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1515	Specific Conductance		2200	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1515	pH		6.2	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1615	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1615	pH		6.2	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1715	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1715	pH		6.2	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1815	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1815	pH		6.1	pH
22-MAR-02	FRIDAY	1_Hr_COMP	1915	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	1915	pH		6	pH
22-MAR-02	FRIDAY	1_Hr_COMP	2015	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	2015	pH		6	pH
22-MAR-02	FRIDAY	1_Hr_COMP	2115	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	2115	pH		6	pH
22-MAR-02	FRIDAY	1_Hr_COMP	2215	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	2215	pH		6	pH
22-MAR-02	FRIDAY	1_Hr_COMP	2315	Specific Conductance		2100	umhos/cm
22-MAR-02	FRIDAY	1_Hr_COMP	2315	pH		6	pH

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
23-MAR-02	SATURDAY	1_Hr_COMP	15	Specific Conductance		2100	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	15	pH		6	pH
23-MAR-02	SATURDAY	1_Hr_COMP	115	Specific Conductance		2100	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	115	pH		6	pH
23-MAR-02	SATURDAY	1_Hr_COMP	215	Specific Conductance		2200	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	215	pH		6	pH
23-MAR-02	SATURDAY	1_Hr_COMP	315	Specific Conductance		2200	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	315	pH		6	pH
23-MAR-02	SATURDAY	1_Hr_COMP	415	Specific Conductance		2200	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	415	pH		6	pH
23-MAR-02	SATURDAY	1_Hr_COMP	515	Specific Conductance		2200	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	515	pH		6	pH
23-MAR-02	SATURDAY	1_Hr_COMP	615	Specific Conductance		2200	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	615	pH		6	pH
23-MAR-02	SATURDAY	1_Hr_COMP	715	Specific Conductance		2200	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	715	pH		6.1	pH
23-MAR-02	SATURDAY	1_Hr_COMP	815	Specific Conductance		2100	umhos/cm
23-MAR-02	SATURDAY	1_Hr_COMP	815	pH		6	pH
23-MAR-02	SATURDAY	COMP_AUTO_CN	1050	Total Cyanide	<	.02	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_COD	1050	Chemical Oxygen Demand		404	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Aluminum		1.06	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Antimony	<	.015	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Arsenic	<	.003	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Barium		.207	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Beryllium	<	.006	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Cadmium	<	.009	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Chromium		.075	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Copper		.064	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Lead	<	.02	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Manganese		.044	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Mercury	<	.002	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Nickel		.088	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Selenium		.006	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Silver	<	.006	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Thallium	<	.001	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_HM	1050	Zinc		.36	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_MBAS	1050	Methylene Blue Active Substances		18.3	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_NH3	1050	Ammonia as (N)		49.6	mg/L
23-MAR-02	SATURDAY	COMP_AUTO_SOLID	1050	Total Suspended Solids		90	mg/L
23-MAR-02	SATURDAY	COMP_CONDUCT	1050	Specific Conductance		2000	umhos/cm
23-MAR-02	SATURDAY	COMP_PH	1050	pH		6.1	pH
23-MAR-02	SATURDAY	GRAB	1100	Specific Conductance		2100	umhos/cm
23-MAR-02	SATURDAY	GRAB	1100	pH		6.7	pH
23-MAR-02	SATURDAY	GRAB_BNA	1100	1,2,4-trichlorobenzene	<	11.1	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	1,2-diphenylhydrazine	<	8.45	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	2,4,6-trichlorophenol	<	8.87	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	2,4-dimethylphenol	<	11	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	2,4-dinitrophenol	<	8.98	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	2,4-dinitrotoluene	<	6	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	2,4_dichlorophenol	<	9.32	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	2,6-dinitrotoluene	<	6.97	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	2-chloronaphthalene	<	7.64	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	2-chlorophenol	<	5	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	2-nitrophenol	<	9.22	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	3,3-dichlorobenzidine	<	9.99	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	4-bromophenyl phenyl ether	<	6.04	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	4-chloro-3-methylphenol	<	7.16	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	4-chlorophenyl phenyl ether	<	4.99	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	4-nitrophenol	<	4.9	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Acenaphthene	<	5.45	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Acenaphthylene	<	8.34	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Anthracene	<	7.16	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Benzidine	<	6.17	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Benzo(A)anthracene	<	5.2	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Benzo(A)pyrene	<	7.69	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Benzo(G,H,I)perylene	<	5.22	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Benzo(K)fluoranthene	<	7.9	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Benzo(b)fluoroanthene	<	6.98	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Bis-(2-ethylhexyl) phthalate		38.2	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Butyl benzyl phthalate	<	7.53	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Chrysene	<	4.04	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Di-n-Butyl phthalate	<	5.89	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Di-n-Octyl phthalate	<	9.17	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
23-MAR-02	SATURDAY	GRAB_BNA	1100	Dibenzo (A,H) Anthracene	<	7.66	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Diethyl Phthalate		8.7	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Dimethyl Phthalate	<	4.64	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Fluoranthene	<	4.68	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Fluorene	<	4.04	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Hexachlorobenzene	<	6.89	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Hexachlorobutadiene	<	9.17	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Hexachlorocyclopentadiene	<	8.87	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Hexachloroethane	<	5.27	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Isophorone	<	6	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	N-nitrosodi-n-propylamine	<	8.67	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	N-nitrosodimethylamine	<	5.4	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	N-nitrosodiphenylamine	<	5.01	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Naphthalene	<	7.47	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Nitrobenzene	<	7.92	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Pentachlorophenol	<	2.73	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Phenanthrene	<	4.76	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Phenol	<	2.43	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	Pyrene	<	4.86	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	bis(2-chloroethoxy)methane	<	10.4	ug/L
23-MAR-02	SATURDAY	GRAB_BNA	1100	bis(2-chloroethyl) ether	<	6.41	ug/L
23-MAR-02	SATURDAY	GRAB_OG	1100	Hexane Extraction Method		23.2	mg/L
23-MAR-02	SATURDAY	GRAB_OG	1100	SGT-HEM-Non Polar Material		5.9	mg/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	Aldrin	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	Alpha Endosulfan	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	BHC, Alpha	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	BHC, Beta	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	BHC, Delta	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	BHC, Gamma (Lindane)	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	Beta Endosulfan	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	Chlordane	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	Dieldrin	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	Endosulfan Sulfate	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	Endrin	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	Endrin aldehyde	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	Heptachlor	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	Heptachlor epoxide	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	PCB 1016	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	PCB 1221	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	PCB 1232	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	PCB 1242	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	PCB 1248	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	PCB 1254	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	PCB 1260	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	PCB-1262	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	Toxaphene	<	.5	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	p,p-DDD	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	p,p-DDE	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_PEST	1100	p,p-DDT	<	.1	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	1,1,1-trichloroethane	<	.78	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	1,1,2,2-tetrachloroethane	<	3.13	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	1,1,2-trichloroethane	<	3.02	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	1,1-dichloroethane	<	.71	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	1,1-dichloroethene	<	1.09	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	1,2-dichlorobenzene	<	1.37	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	1,2-dichloroethane	<	2.24	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	1,2-dichloropropane	<	.83	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	1,3-dichlorobenzene	<	1.31	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	1,4-dichlorobenzene		1.45	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	2-chloroethylvinyl ether	<	1.35	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Benzene	<	.92	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Bromodichloromethane	<	1.79	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Bromoform	<	3.58	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Bromomethane	<	1.39	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Carbon tetrachloride	<	1.92	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Chlorobenzene	<	1	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Chloroethane	<	.95	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Chloroform		2.73	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Chloromethane	<	3.23	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Dibromochloromethane	<	1.99	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Ethylbenzene	<	1.46	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Methylene chloride	<	1.29	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Tetrachloroethene	<	1.04	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Toluene		17.3	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
23-MAR-02	SATURDAY	GRAB_VOC	1100	Trichloroethene	<	1.32	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Trichlorofluoromethane	<	3.92	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	Vinyl chloride	<	1.04	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	cis-1,3-dichloropropene	<	1.01	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	trans-1,2-dichloroethene	<	.61	ug/L
23-MAR-02	SATURDAY	GRAB_VOC	1100	trans-1,3-dichloropropene	<	1.27	ug/L

SITE 3

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
07-APR-02	SUNDAY	1_Hr_COMP	1000	Specific Conductance		3900	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1000	pH		8.6	pH
07-APR-02	SUNDAY	1_Hr_COMP	1100	Specific Conductance		3200	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1100	pH		8.5	pH
07-APR-02	SUNDAY	1_Hr_COMP	1200	Specific Conductance		2800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1200	pH		8.5	pH
07-APR-02	SUNDAY	1_Hr_COMP	1300	Specific Conductance		2800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1300	pH		8.7	pH
07-APR-02	SUNDAY	1_Hr_COMP	1400	Specific Conductance		2400	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1400	pH		8.6	pH
07-APR-02	SUNDAY	1_Hr_COMP	1500	Specific Conductance		2500	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1500	pH		8.4	pH
07-APR-02	SUNDAY	1_Hr_COMP	1600	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1600	pH		8.1	pH
07-APR-02	SUNDAY	1_Hr_COMP	1700	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1700	pH		8.1	pH
07-APR-02	SUNDAY	1_Hr_COMP	1800	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1800	pH		7.5	pH
07-APR-02	SUNDAY	1_Hr_COMP	1900	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	1900	pH		7.6	pH
07-APR-02	SUNDAY	1_Hr_COMP	2000	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	2000	pH		8	pH
07-APR-02	SUNDAY	1_Hr_COMP	2100	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	2100	pH		8.2	pH
07-APR-02	SUNDAY	1_Hr_COMP	2200	Specific Conductance		1700	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	2200	pH		8.2	pH
07-APR-02	SUNDAY	1_Hr_COMP	2300	Specific Conductance		1900	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	2300	pH		8.1	pH
07-APR-02	SUNDAY	1_Hr_COMP	2400	Specific Conductance		1800	umhos/cm
07-APR-02	SUNDAY	1_Hr_COMP	2400	pH		8.2	pH
08-APR-02	MONDAY	1_Hr_COMP	100	Specific Conductance		1600	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	100	pH		8.1	pH
08-APR-02	MONDAY	1_Hr_COMP	200	Specific Conductance		1500	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	200	pH		8.1	pH
08-APR-02	MONDAY	1_Hr_COMP	300	Specific Conductance		1500	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	300	pH		8.2	pH
08-APR-02	MONDAY	1_Hr_COMP	400	Specific Conductance		1400	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	400	pH		8.1	pH
08-APR-02	MONDAY	1_Hr_COMP	500	Specific Conductance		1900	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	500	pH		8.2	pH
08-APR-02	MONDAY	1_Hr_COMP	600	Specific Conductance		1600	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	600	pH		8.5	pH
08-APR-02	MONDAY	1_Hr_COMP	700	Specific Conductance		2700	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	700	pH		7.9	pH
08-APR-02	MONDAY	1_Hr_COMP	800	Specific Conductance		2600	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	800	pH		8.6	pH
08-APR-02	MONDAY	1_Hr_COMP	900	Specific Conductance		2300	umhos/cm
08-APR-02	MONDAY	1_Hr_COMP	900	pH		8.8	pH
08-APR-02	MONDAY	COMP_AUTO_BOD	1055	Biochemical Oxygen Demand (BOD)		240	mg/L
08-APR-02	MONDAY	COMP_AUTO_CN	1055	Total Cyanide	<	.02	mg/L
08-APR-02	MONDAY	COMP_AUTO_COD	1055	Chemical Oxygen Demand		581	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Aluminum		1.47	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Antimony	<	.015	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Arsenic		.005	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Barium		.507	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Beryllium	<	.006	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Cadmium	<	.009	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Chromium		.681	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Copper		.16	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Lead	<	.02	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Manganese		.029	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Mercury	<	.002	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Nickel		1.38	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Selenium		.003	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Silver	<	.006	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Thallium	<	.001	mg/L
08-APR-02	MONDAY	COMP_AUTO_HM	1055	Zinc		1.06	mg/L
08-APR-02	MONDAY	COMP_AUTO_MBAS	1055	Methylene Blue Active Substances		18	mg/L
08-APR-02	MONDAY	COMP_AUTO_NH3	1055	Ammonia as (N)		39.2	mg/L
08-APR-02	MONDAY	COMP_AUTO_SOLID	1055	Total Suspended Solids		150	mg/L
08-APR-02	MONDAY	COMP_CONDUCT	1055	Specific Conductance		1300	umhos/cm
08-APR-02	MONDAY	COMP_PH	1055	pH		8.2	pH
08-APR-02	MONDAY	GRAB	1110	Specific Conductance		2400	umhos/cm
08-APR-02	MONDAY	GRAB	1110	pH		8.9	pH
08-APR-02	MONDAY	GRAB_BNA	1110	1,2,4-trichlorobenzene	<	11.1	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	1,2-diphenylhydrazine	<	8.45	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
08-APR-02	MONDAY	GRAB_BNA	1110	2,4,6-trichlorophenol	<	8.87	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	2,4-dimethylphenol	<	11	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	2,4-dinitrophenol	<	8.98	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	2,4-dinitrotoluene	<	6	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	2,4_dichlorophenol	<	9.32	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	2,6-dinitrotoluene	<	6.97	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	2-chloronaphthalene	<	7.64	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	2-chlorophenol	<	5	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	2-nitrophenol	<	9.22	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	3,3-dichlorobenzidine	<	9.99	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	4-bromophenyl phenyl ether	<	6.04	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	4-chloro-3-methylphenol	<	7.16	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	4-chlorophenyl phenyl ether	<	4.99	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	4-nitrophenol	<	4.9	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Acenaphthene	<	5.45	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Acenaphthylene	<	8.34	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Anthracene	<	7.16	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Benzidine	<	6.17	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Benzo(A)anthracene	<	5.2	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Benzo(A)pyrene	<	7.69	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Benzo(G,H,I)perylene	<	5.22	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Benzo(K)fluoranthene	<	7.9	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Benzo(b)fluoroanthene	<	6.98	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Bis-(2-ethylhexyl) phthalate		62.5	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Butyl benzyl phthalate	<	7.53	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Chrysene	<	4.04	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Di-n-Butyl phthalate	<	5.89	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Di-n-Octyl phthalate	<	9.17	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Dibenzo (A,H) Anthracene	<	7.66	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Diethyl Phthalate		13.4	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Dimethyl Phthalate	<	4.64	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Fluoranthene	<	4.68	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Fluorene	<	4.04	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Hexachlorobenzene	<	6.89	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Hexachlorobutadiene	<	9.17	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Hexachlorocyclopentadiene	<	8.87	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Hexachloroethane	<	5.27	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Isophorone	<	6	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	N-nitrosodi-n-propylamine	<	8.67	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	N-nitrosodimethylamine	<	5.4	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	N-nitrosodiphenylamine	<	5.01	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Naphthalene	<	7.47	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Nitrobenzene	<	7.92	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Pentachlorophenol	<	2.73	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Phenanthrene	<	4.76	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Phenol		24.9	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	Pyrene	<	4.86	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	bis(2-chloroethoxy)methane	<	10.4	ug/L
08-APR-02	MONDAY	GRAB_BNA	1110	bis(2-chloroethyl) ether	<	6.41	ug/L
08-APR-02	MONDAY	GRAB_OG	1110	Hexane Extraction Method		67.5	mg/L
08-APR-02	MONDAY	GRAB_OG	1110	SGT-HEM-Non Polar Material	<	5	mg/L
08-APR-02	MONDAY	GRAB_PEST	1110	Aldrin	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Alpha Endosulfan	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	BHC, Alpha	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	BHC, Beta	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	BHC, Delta	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	BHC, Gamma (Lindane)	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Beta Endosulfan	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Chlordane	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Chlorpyrifos		.16	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Demeton-O	<	.09	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Demeton-S	<	.05	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Diazinon		.07	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Dieldrin	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Endosulfan Sulfate	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Endrin	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Endrin aldehyde	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Guthion	<	.21	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Heptachlor	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Heptachlor epoxide	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Malathion	<	.04	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	PCB 1016	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	PCB 1221	<	.5	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
08-APR-02	MONDAY	GRAB_PEST	1110	PCB 1232	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	PCB 1242	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	PCB 1248	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	PCB 1254	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	PCB 1260	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	PCB-1262	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Parathion	<	.03	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	Toxaphene	<	.5	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	p,p-DDD	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	p,p-DDE	<	.1	ug/L
08-APR-02	MONDAY	GRAB_PEST	1110	p,p-DDT	<	.1	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	1,1,1-trichloroethane	<	.78	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	1,1,2,2-tetrachloroethane	<	3.13	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	1,1,2-trichloroethane	<	3.02	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	1,1-dichloroethane	<	.71	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	1,1-dichloroethene	<	1.09	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	1,2-dichlorobenzene	<	1.37	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	1,2-dichloroethane	<	2.24	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	1,2-dichloropropane	<	.83	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	1,3-dichlorobenzene	<	1.31	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	1,4-dichlorobenzene		5.56	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	2-chloroethylvinyl ether	<	1.35	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Benzene		3.28	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Bromodichloromethane		2.82	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Bromoform	<	3.58	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Bromomethane	<	1.39	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Carbon tetrachloride	<	1.92	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Chlorobenzene	<	1	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Chloroethane	<	.95	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Chloroform		3.71	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Chloromethane	<	3.23	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Dibromochloromethane		4.31	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Ethylbenzene		23.7	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Methylene chloride	<	1.29	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Tetrachloroethene	<	1.04	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Toluene		56.3	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Trichloroethene	<	1.32	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Trichlorofluoromethane	<	3.92	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	Vinyl chloride	<	1.04	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	cis-1,3-dichloropropene	<	1.01	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	trans-1,2-dichloroethene	<	.61	ug/L
08-APR-02	MONDAY	GRAB_VOC	1110	trans-1,3-dichloropropene	<	1.27	ug/L
15-APR-02	MONDAY	1_Hr_COMP	945	Specific Conductance		2200	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	945	pH		7.7	pH
15-APR-02	MONDAY	1_Hr_COMP	1045	Specific Conductance		2600	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1045	pH		7.8	pH
15-APR-02	MONDAY	1_Hr_COMP	1145	Specific Conductance		2300	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1145	pH		7.7	pH
15-APR-02	MONDAY	1_Hr_COMP	1245	Specific Conductance		2400	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1245	pH		7.7	pH
15-APR-02	MONDAY	1_Hr_COMP	1345	Specific Conductance		2400	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1345	pH		8.3	pH
15-APR-02	MONDAY	1_Hr_COMP	1445	Specific Conductance		2400	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1445	pH		7.8	pH
15-APR-02	MONDAY	1_Hr_COMP	1545	Specific Conductance		2800	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1545	pH		7.8	pH
15-APR-02	MONDAY	1_Hr_COMP	1645	Specific Conductance		2500	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1645	pH		7.4	pH
15-APR-02	MONDAY	1_Hr_COMP	1745	Specific Conductance		2300	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1745	pH		7.2	pH
15-APR-02	MONDAY	1_Hr_COMP	1845	Specific Conductance		2100	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1845	pH		7.7	pH
15-APR-02	MONDAY	1_Hr_COMP	1945	Specific Conductance		3700	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	1945	pH		8	pH
15-APR-02	MONDAY	1_Hr_COMP	2045	Specific Conductance		2300	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	2045	pH		8.2	pH
15-APR-02	MONDAY	1_Hr_COMP	2145	Specific Conductance		2400	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	2145	pH		8.4	pH
15-APR-02	MONDAY	1_Hr_COMP	2245	Specific Conductance		2400	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	2245	pH		8.4	pH
15-APR-02	MONDAY	1_Hr_COMP	2345	Specific Conductance		2600	umhos/cm
15-APR-02	MONDAY	1_Hr_COMP	2345	pH		8.5	pH
16-APR-02	TUESDAY	1_Hr_COMP	45	Specific Conductance		2800	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	45	pH		8.7	pH
16-APR-02	TUESDAY	1_Hr_COMP	145	Specific Conductance		2800	umhos/cm

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
16-APR-02	TUESDAY	1_Hr_COMP	145	pH		8.6	pH
16-APR-02	TUESDAY	1_Hr_COMP	245	Specific Conductance		2500	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	245	pH		8.6	pH
16-APR-02	TUESDAY	1_Hr_COMP	345	Specific Conductance		2700	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	345	pH		8.6	pH
16-APR-02	TUESDAY	1_Hr_COMP	445	Specific Conductance		5700	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	445	pH		8.4	pH
16-APR-02	TUESDAY	1_Hr_COMP	545	Specific Conductance		2600	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	545	pH		8.5	pH
16-APR-02	TUESDAY	PH_HIGH	640	pH_High_150.1		8.7	pH
16-APR-02	TUESDAY	1_Hr_COMP	645	Specific Conductance		2400	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	645	pH		8.8	pH
16-APR-02	TUESDAY	1_Hr_COMP	745	Specific Conductance		2200	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	745	pH		8.7	pH
16-APR-02	TUESDAY	1_Hr_COMP	845	Specific Conductance		2400	umhos/cm
16-APR-02	TUESDAY	1_Hr_COMP	845	pH		8.6	pH
16-APR-02	TUESDAY	COMP_AUTO_BOD	1030	Biochemical Oxygen Demand (BOD)		246	mg/L
16-APR-02	TUESDAY	COMP_AUTO_CN	1030	Total Cyanide	<	.02	mg/L
16-APR-02	TUESDAY	COMP_AUTO_COD	1030	Chemical Oxygen Demand		605	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Aluminum		1.54	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Antimony	<	.015	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Arsenic		.005	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Barium		.739	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Beryllium	<	.006	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Cadmium	<	.009	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Chromium		1.3	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Copper		.228	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Lead		.02	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Manganese		.027	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Mercury	<	.002	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Nickel		1.53	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Selenium	<	.003	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Silver	<	.006	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Thallium	<	.001	mg/L
16-APR-02	TUESDAY	COMP_AUTO_HM	1030	Zinc		1.66	mg/L
16-APR-02	TUESDAY	COMP_AUTO_MBAS	1030	Methylene Blue Active Substances		15.4	mg/L
16-APR-02	TUESDAY	COMP_AUTO_NH3	1030	Ammonia as (N)		33.3	mg/L
16-APR-02	TUESDAY	COMP_AUTO_SOLID	1030	Total Suspended Solids		152	mg/L
16-APR-02	TUESDAY	COMP_CONDUCT	1030	Specific Conductance		2800	umhos/cm
16-APR-02	TUESDAY	COMP_PH	1030	pH		8	pH
16-APR-02	TUESDAY	GRAB	1045	Specific Conductance		2000	umhos/cm
16-APR-02	TUESDAY	GRAB	1045	pH		8.4	pH
16-APR-02	TUESDAY	GRAB_BNA	1045	1,2,4-trichlorobenzene	<	11.1	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	1,2-diphenylhydrazine	<	8.45	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	2,4,6-trichlorophenol	<	8.87	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	2,4-dimethylphenol	<	11	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	2,4-dinitrophenol	<	8.98	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	2,4-dinitrotoluene	<	6	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	2,4_dichlorophenol	<	9.32	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	2,6-dinitrotoluene	<	6.97	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	2-chloronaphthalene	<	7.64	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	2-chlorophenol	<	5	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	2-nitrophenol	<	9.22	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	3,3-dichlorobenzidine	<	9.99	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	4-bromophenyl phenyl ether	<	6.04	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	4-chloro-3-methylphenol	<	7.16	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	4-chlorophenyl phenyl ether	<	4.99	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	4-nitrophenol	<	4.9	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Acenaphthene	<	5.45	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Acenaphthylene	<	8.34	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Anthracene	<	7.16	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Benzidine	<	6.17	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Benzo(A)anthracene	<	5.2	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Benzo(A)pyrene	<	7.69	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Benzo(G,H,I)perylene	<	5.22	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Benzo(K)fluoranthene	<	7.9	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Benzo(b)fluoroanthene	<	6.98	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Bis-(2-ethylhexyl) phthalate		56	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Butyl benzyl phthalate	<	7.53	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Chrysene	<	4.04	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Di-n-Butyl phthalate	<	5.89	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Di-n-Octyl phthalate	<	9.17	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Dibenzo (A,H) Anthracene	<	7.66	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
16-APR-02	TUESDAY	GRAB_BNA	1045	Diethyl Phthalate		21.2	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Dimethyl Phthalate	<	4.64	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Fluoranthene	<	4.68	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Fluorene	<	4.04	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Hexachlorobenzene	<	6.89	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Hexachlorobutadiene	<	9.17	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Hexachlorocyclopentadiene	<	8.87	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Hexachloroethane	<	5.27	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Isophorone	<	6	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	N-nitrosodi-n-propylamine	<	8.67	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	N-nitrosodimethylamine	<	5.4	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	N-nitrosodiphenylamine	<	5.01	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Naphthalene	<	7.47	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Nitrobenzene	<	7.92	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Pentachlorophenol	<	2.73	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Phenanthrene	<	4.76	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Phenol		317	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	Pyrene	<	4.86	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	bis(2-chloroethoxy)methane	<	10.4	ug/L
16-APR-02	TUESDAY	GRAB_BNA	1045	bis(2-chloroethyl) ether	<	6.41	ug/L
16-APR-02	TUESDAY	GRAB_OG	1045	Hexane Extraction Method		111	mg/L
16-APR-02	TUESDAY	GRAB_OG	1045	SGT-HEM-Non Polar Material		14.5	mg/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Aldrin	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Alpha Endosulfan	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	BHC, Alpha	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	BHC, Beta	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	BHC, Delta	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	BHC, Gamma (Lindane)	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Beta Endosulfan	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Chlordane	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Chlorpyrifos		.092	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Demeton-O	<	.09	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Demeton-S	<	.05	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Diazinon		.12	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Dieldrin	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Endosulfan Sulfate	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Endrin	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Endrin aldehyde	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Guthion	<	.21	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Heptachlor	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Heptachlor epoxide	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Malathion		.11	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	PCB 1016	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	PCB 1221	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	PCB 1232	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	PCB 1242	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	PCB 1248	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	PCB 1254	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	PCB 1260	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	PCB-1262	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Parathion	<	.03	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	Toxaphene	<	.5	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	p,p-DDD	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	p,p-DDE	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_PEST	1045	p,p-DDT	<	.1	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	1,1,1-trichloroethane	<	.78	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	1,1,2,2-tetrachloroethane	<	3.13	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	1,1,2-trichloroethane	<	3.02	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	1,1-dichloroethane	<	.71	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	1,1-dichloroethene	<	1.09	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	1,2-dichlorobenzene	<	1.37	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	1,2-dichloroethane	<	2.24	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	1,2-dichloropropane	<	.83	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	1,3-dichlorobenzene	<	1.31	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	1,4-dichlorobenzene		6.98	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	2-chloroethylvinyl ether	<	1.35	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Benzene	<	.81	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Bromodichloromethane		2.72	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Bromoform	<	3.58	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Bromomethane	<	1.39	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Carbon tetrachloride	<	1.92	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Chlorobenzene	<	1	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Chloroethane	<	.95	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Chloroform		3.95	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
16-APR-02	TUESDAY	GRAB_VOC	1045	Chloromethane	<	3.23	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Dibromochloromethane		3.92	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Ethylbenzene	<	1.46	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Methylene chloride	<	1.29	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Tetrachloroethene	<	1.04	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Toluene		1.8	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Trichloroethene	<	1.32	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Trichlorofluoromethane	<	3.92	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	Vinyl chloride	<	1.04	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	cis-1,3-dichloropropene	<	1.01	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	trans-1,2-dichloroethene	<	.61	ug/L
16-APR-02	TUESDAY	GRAB_VOC	1045	trans-1,3-dichloropropene	<	1.27	ug/L
16-APR-02	TUESDAY	PH_LOW	1500	pH_Low_150.1		6.3	pH
23-APR-02	TUESDAY	1_Hr_COMP	1045	Specific Conductance		2800	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1045	pH		8	pH
23-APR-02	TUESDAY	1_Hr_COMP	1145	Specific Conductance		2600	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1145	pH		7.8	pH
23-APR-02	TUESDAY	1_Hr_COMP	1245	Specific Conductance		2700	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1245	pH		8	pH
23-APR-02	TUESDAY	1_Hr_COMP	1345	Specific Conductance		2600	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1345	pH		8	pH
23-APR-02	TUESDAY	1_Hr_COMP	1445	Specific Conductance		2800	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1445	pH		8	pH
23-APR-02	TUESDAY	1_Hr_COMP	1545	Specific Conductance		2800	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1545	pH		8	pH
23-APR-02	TUESDAY	1_Hr_COMP	1645	Specific Conductance		2700	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1645	pH		7.9	pH
23-APR-02	TUESDAY	1_Hr_COMP	1745	Specific Conductance		2500	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1745	pH		7.8	pH
23-APR-02	TUESDAY	1_Hr_COMP	1845	Specific Conductance		2900	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1845	pH		7.8	pH
23-APR-02	TUESDAY	1_Hr_COMP	1945	Specific Conductance		2700	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	1945	pH		8.1	pH
23-APR-02	TUESDAY	1_Hr_COMP	2045	Specific Conductance		2300	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	2045	pH		7.7	pH
23-APR-02	TUESDAY	1_Hr_COMP	2145	Specific Conductance		8600	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	2145	pH		7.8	pH
23-APR-02	TUESDAY	1_Hr_COMP	2245	Specific Conductance		2600	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	2245	pH		8.1	pH
23-APR-02	TUESDAY	1_Hr_COMP	2345	Specific Conductance		2800	umhos/cm
23-APR-02	TUESDAY	1_Hr_COMP	2345	pH		8.2	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	45	Specific Conductance		4100	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	45	pH		8.6	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	145	Specific Conductance		4900	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	145	pH		8.7	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	245	Specific Conductance		5300	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	245	pH		8.8	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	345	Specific Conductance		4200	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	345	pH		8.7	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	445	Specific Conductance		4100	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	445	pH		8.5	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	545	Specific Conductance		4200	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	545	pH		8.2	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	645	Specific Conductance		2700	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	645	pH		8.5	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	745	Specific Conductance		2600	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	745	pH		8.5	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	845	Specific Conductance		3000	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	845	pH		8.6	pH
24-APR-02	WEDNESDAY	1_Hr_COMP	945	Specific Conductance		2700	umhos/cm
24-APR-02	WEDNESDAY	1_Hr_COMP	945	pH		8.7	pH
24-APR-02	WEDNESDAY	COMP_AUTO_BOD	1115	Biochemical Oxygen Demand (BOD)		460	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_CN	1115	Total Cyanide	<	.02	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_COD	1115	Chemical Oxygen Demand		966	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Aluminum		1.89	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Antimony	<	.015	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Arsenic		.004	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Barium		.325	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Beryllium	<	.006	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Cadmium	<	.009	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Chromium		1.05	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Copper		.186	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Lead	<	.02	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Manganese		.031	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Mercury	<	.002	mg/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Nickel		.323	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Selenium		.003	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Silver	<	.006	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Thallium	<	.001	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_HM	1115	Zinc		.579	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_MBAS	1115	Methylene Blue Active Substances		18.3	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_NH3	1115	Ammonia as (N)		33.2	mg/L
24-APR-02	WEDNESDAY	COMP_AUTO_SOLID	1115	Total Suspended Solids		140	mg/L
24-APR-02	WEDNESDAY	COMP_CONDUCT	1115	Specific Conductance		3300	umhos/cm
24-APR-02	WEDNESDAY	COMP_PH	1115	pH		8.1	pH
24-APR-02	WEDNESDAY	GRAB	1130	Specific Conductance		3300	umhos/cm
24-APR-02	WEDNESDAY	GRAB	1130	pH		8.7	pH
24-APR-02	WEDNESDAY	GRAB_BNA	1130	1,2,4-trichlorobenzene	<	11.1	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	1,2-diphenylhydrazine	<	8.45	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	2,4,6-trichlorophenol	<	8.87	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	2,4-dimethylphenol	<	11	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	2,4-dinitrophenol	<	8.98	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	2,4-dinitrotoluene	<	6	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	2,4_dichlorophenol	<	9.32	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	2,6-dinitrotoluene	<	6.97	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	2-chloronaphthalene	<	7.64	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	2-chlorophenol	<	5	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	2-nitrophenol	<	9.22	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	3,3-dichlorobenzidine	<	9.99	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	4-bromophenyl phenyl ether	<	6.04	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	4-chloro-3-methylphenol	<	7.16	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	4-chlorophenyl phenyl ether	<	4.99	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	4-nitrophenol	<	4.9	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Acenaphthene	<	5.45	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Acenaphthylene	<	8.34	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Anthracene	<	7.16	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Benzidine	<	6.17	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Benzo(A)anthracene	<	5.2	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Benzo(A)pyrene	<	7.69	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Benzo(G,H,I)perylene	<	5.22	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Benzo(K)fluoranthene	<	7.9	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Benzo(b)fluoroanthene	<	6.98	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Bis-(2-ethylhexyl) phthalate		15.9	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Butyl benzyl phthalate	<	7.53	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Chrysene	<	4.04	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Di-n-Butyl phthalate	<	5.89	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Di-n-Octyl phthalate	<	9.17	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Dibenzo (A,H) Anthracene	<	7.66	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Diethyl Phthalate		18.4	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Dimethyl Phthalate	<	4.64	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Fluoranthene	<	4.68	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Fluorene	<	4.04	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Hexachlorobenzene	<	6.89	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Hexachlorobutadiene	<	9.17	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Hexachlorocyclopentadiene	<	8.87	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Hexachloroethane	<	5.27	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Isophorone	<	6	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	N-nitrosodi-n-propylamine	<	8.67	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	N-nitrosodimethylamine	<	5.4	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	N-nitrosodiphenylamine	<	5.01	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Naphthalene	<	7.47	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Nitrobenzene	<	7.92	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Pentachlorophenol	<	2.73	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Phenanthrene	<	4.76	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Phenol	<	2.43	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	Pyrene	<	4.86	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	bis(2-chloroethoxy)methane	<	10.4	ug/L
24-APR-02	WEDNESDAY	GRAB_BNA	1130	bis(2-chloroethyl) ether	<	6.41	ug/L
24-APR-02	WEDNESDAY	GRAB_OG	1130	Hexane Extraction Method		49.8	mg/L
24-APR-02	WEDNESDAY	GRAB_OG	1130	SGT-HEM-Non Polar Material		8.87	mg/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Aldrin	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Alpha Endosulfan	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	BHC, Alpha	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	BHC, Beta	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	BHC, Delta	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	BHC, Gamma (Lindane)	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Beta Endosulfan	<	.1	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Chlordane	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Chlorpyrifos		.083	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Demeton-O	<	.09	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Demeton-S	<	.05	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Diazinon		.12	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Dieldrin	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Endosulfan Sulfate	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Endrin	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Endrin aldehyde	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Guthion	<	.21	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Heptachlor	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Heptachlor epoxide	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Malathion	<	.04	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	PCB 1016	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	PCB 1221	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	PCB 1232	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	PCB 1242	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	PCB 1248	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	PCB 1254	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	PCB 1260	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	PCB-1262	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Parathion	<	.03	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	Toxaphene	<	.5	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	p,p-DDD	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	p,p-DDE	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_PEST	1130	p,p-DDT	<	.1	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	1,1,1-trichloroethane	<	.78	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	1,1,2,2-tetrachloroethane	<	3.13	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	1,1,2-trichloroethane	<	3.02	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	1,1-dichloroethane	<	.71	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	1,1-dichloroethene	<	1.09	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	1,2-dichlorobenzene	<	1.37	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	1,2-dichloroethane	<	2.24	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	1,2-dichloropropane	<	.83	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	1,3-dichlorobenzene	<	1.31	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	1,4-dichlorobenzene		5.81	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	2-chloroethylvinyl ether	<	1.35	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Benzene	<	.81	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Bromodichloromethane		3.28	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Bromoform	<	3.58	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Bromomethane	<	1.39	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Carbon tetrachloride	<	1.92	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Chlorobenzene	<	1	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Chloroethane	<	.95	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Chloroform		3.83	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Chloromethane	<	3.23	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Dibromochloromethane		4.12	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Ethylbenzene	<	1.46	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Methylene chloride	<	1.29	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Tetrachloroethene	<	1.04	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Toluene	<	1.01	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Trichloroethene	<	1.32	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Trichlorofluoromethane	<	3.92	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	Vinyl chloride	<	1.04	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	cis-1,3-dichloropropene	<	1.01	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	trans-1,2-dichloroethene	<	.61	ug/L
24-APR-02	WEDNESDAY	GRAB_VOC	1130	trans-1,3-dichloropropene	<	1.27	ug/L
01-MAY-02	WEDNESDAY	1_Hr_COMP	1000	Specific Conductance		3700	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1000	pH		8.4	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1100	Specific Conductance		6300	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1100	pH		8.2	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1200	Specific Conductance		5700	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1200	pH		7.8	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1300	Specific Conductance		3000	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1300	pH		7.6	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1400	Specific Conductance		2900	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1400	pH		7.5	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1500	Specific Conductance		3000	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1500	pH		7.3	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1600	Specific Conductance		2500	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1600	pH		7.3	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1700	Specific Conductance		2300	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1700	pH		7.3	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	1800	Specific Conductance		2300	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1800	pH		7.3	pH

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
01-MAY-02	WEDNESDAY	1_Hr_COMP	1900	Specific Conductance		2700	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	1900	pH		7.3	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	2000	Specific Conductance		3200	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	2000	pH		7.2	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	2100	Specific Conductance		2700	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	2100	pH		7.5	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	2200	Specific Conductance		2300	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	2200	pH		7.7	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	2300	Specific Conductance		2600	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	2300	pH		7.4	pH
01-MAY-02	WEDNESDAY	1_Hr_COMP	2400	Specific Conductance		2500	umhos/cm
01-MAY-02	WEDNESDAY	1_Hr_COMP	2400	pH		7.4	pH
02-MAY-02	THURSDAY	1_Hr_COMP	100	Specific Conductance		2300	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	100	pH		7.6	pH
02-MAY-02	THURSDAY	1_Hr_COMP	200	Specific Conductance		2500	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	200	pH		7.4	pH
02-MAY-02	THURSDAY	1_Hr_COMP	300	Specific Conductance		2800	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	300	pH		7.5	pH
02-MAY-02	THURSDAY	1_Hr_COMP	400	Specific Conductance		3900	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	400	pH		7.5	pH
02-MAY-02	THURSDAY	1_Hr_COMP	500	Specific Conductance		5200	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	500	pH		7.5	pH
02-MAY-02	THURSDAY	1_Hr_COMP	600	Specific Conductance		2800	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	600	pH		8.2	pH
02-MAY-02	THURSDAY	1_Hr_COMP	700	Specific Conductance		3000	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	700	pH		7.9	pH
02-MAY-02	THURSDAY	1_Hr_COMP	800	Specific Conductance		3000	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	800	pH		7.9	pH
02-MAY-02	THURSDAY	1_Hr_COMP	900	Specific Conductance		3900	umhos/cm
02-MAY-02	THURSDAY	1_Hr_COMP	900	pH		7.7	pH
02-MAY-02	THURSDAY	COMP_AUTO_BOD	1105	Biochemical Oxygen Demand (BOD)		202	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_CN	1105	Total Cyanide	<	.02	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_COD	1105	Chemical Oxygen Demand		560	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Aluminum		3.14	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Antimony	<	.015	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Arsenic	<	.003	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Barium		.21	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Beryllium	<	.006	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Cadmium	<	.009	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Chromium		8.49	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Copper		1.71	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Lead		.11	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Manganese		.036	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Mercury	<	.002	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Nickel		14.2	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Selenium		.005	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Silver	<	.006	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Thallium	<	.001	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_HM	1105	Zinc		5.44	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_MBAS	1105	Methylene Blue Active Substances		15.3	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_NH3	1105	Ammonia as (N)		32.8	mg/L
02-MAY-02	THURSDAY	COMP_AUTO_SOLID	1105	Total Suspended Solids		222	mg/L
02-MAY-02	THURSDAY	COMP_CONDUCT	1105	Specific Conductance		3200	umhos/cm
02-MAY-02	THURSDAY	COMP_PH	1105	pH		7.5	pH
02-MAY-02	THURSDAY	GRAB	1115	Specific Conductance		3200	umhos/cm
02-MAY-02	THURSDAY	GRAB	1115	pH		8.6	pH
02-MAY-02	THURSDAY	GRAB_BNA	1115	1,2,4-trichlorobenzene	<	11.1	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	1,2-diphenylhydrazine	<	8.45	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	2,4,6-trichlorophenol	<	8.87	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	2,4-dimethylphenol	<	11	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	2,4-dinitrophenol	<	8.98	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	2,4-dinitrotoluene	<	6	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	2,4_dichlorophenol	<	9.32	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	2,6-dinitrotoluene	<	6.97	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	2-chloronaphthalene	<	7.64	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	2-chlorophenol	<	5	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	2-nitrophenol	<	9.22	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	3,3-dichlorobenzidine	<	9.99	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	4-bromophenyl phenyl ether	<	6.04	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	4-chloro-3-methylphenol	<	7.16	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	4-chlorophenyl phenyl ether	<	4.99	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	4-nitrophenol	<	4.9	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Acenaphthene	<	5.45	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Acenaphthylene	<	8.34	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
02-MAY-02	THURSDAY	GRAB_BNA	1115	Anthracene	<	7.16	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Benzidine	<	6.17	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Benzo(A)anthracene	<	5.2	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Benzo(A)pyrene	<	7.69	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Benzo(G,H,I)perylene	<	5.22	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Benzo(K)fluoranthene	<	7.9	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Benzo(b)fluoroanthene	<	6.98	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Bis-(2-ethylhexyl) phthalate		101	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Butyl benzyl phthalate	<	7.53	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Chrysene	<	4.04	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Di-n-Butyl phthalate	<	5.89	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Di-n-Octyl phthalate	<	9.17	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Dibenzo (A,H) Anthracene	<	7.66	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Diethyl Phthalate		16.8	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Dimethyl Phthalate	<	4.64	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Fluoranthene	<	4.68	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Fluorene	<	4.04	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Hexachlorobenzene	<	6.89	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Hexachlorobutadiene	<	9.17	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Hexachlorocyclopentadiene	<	8.87	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Hexachloroethane	<	5.27	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Isophorone	<	6	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	N-nitrosodi-n-propylamine	<	8.67	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	N-nitrosodimethylamine	<	5.4	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	N-nitrosodiphenylamine	<	5.01	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Naphthalene	<	7.47	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Nitrobenzene	<	7.92	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Pentachlorophenol	<	2.73	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Phenanthrene	<	4.76	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Phenol		109	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	Pyrene	<	4.86	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	bis(2-chloroethoxy)methane	<	10.4	ug/L
02-MAY-02	THURSDAY	GRAB_BNA	1115	bis(2-chloroethyl) ether	<	6.41	ug/L
02-MAY-02	THURSDAY	GRAB_OG	1115	Hexane Extraction Method		87.6	mg/L
02-MAY-02	THURSDAY	GRAB_OG	1115	SGT-HEM-Non Polar Material		16.6	mg/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	Aldrin	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	Alpha Endosulfan	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	BHC, Alpha	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	BHC, Beta	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	BHC, Delta	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	BHC, Gamma (Lindane)	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	Beta Endosulfan	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	Chlordane	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	Dieldrin	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	Endosulfan Sulfate	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	Endrin	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	Endrin aldehyde	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	Heptachlor	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	Heptachlor epoxide	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	PCB 1016	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	PCB 1221	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	PCB 1232	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	PCB 1242	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	PCB 1248	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	PCB 1254	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	PCB 1260	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	PCB-1262	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	Toxaphene	<	.5	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	p,p-DDD	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	p,p-DDE	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_PEST	1115	p,p-DDT	<	.1	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	1,1,1-trichloroethane	<	.78	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	1,1,2,2-tetrachloroethane	<	3.13	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	1,1,2-trichloroethane	<	3.02	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	1,1-dichloroethane	<	.71	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	1,1-dichloroethene	<	1.09	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	1,2-dichlorobenzene	<	1.37	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	1,2-dichloroethane	<	2.24	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	1,2-dichloropropane	<	.83	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	1,3-dichlorobenzene	<	1.31	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	1,4-dichlorobenzene		5.94	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	2-chloroethylvinyl ether	<	1.35	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Benzene	<	.81	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
02-MAY-02	THURSDAY	GRAB_VOC	1115	Bromodichloromethane		3.79	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Bromoform	<	3.58	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Bromomethane	<	1.39	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Carbon tetrachloride	<	1.92	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Chlorobenzene	<	1	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Chloroethane	<	.95	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Chloroform		5.26	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Chloromethane	<	3.23	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Dibromochloromethane		5.3	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Ethylbenzene	<	1.46	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Methylene chloride	<	1.29	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Tetrachloroethene	<	1.04	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Toluene		2.85	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Trichloroethene	<	1.32	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Trichlorofluoromethane	<	3.92	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	Vinyl chloride	<	1.04	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	cis-1,3-dichloropropene	<	1.01	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	trans-1,2-dichloroethene	<	.61	ug/L
02-MAY-02	THURSDAY	GRAB_VOC	1115	trans-1,3-dichloropropene	<	1.27	ug/L

SITE 4

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Aluminum		.264	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Antimony	<	.015	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Arsenic	<	.003	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Barium		.085	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Beryllium	<	.006	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Cadmium	<	.009	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Chromium		1.18	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Copper		.249	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Lead		.028	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Manganese	<	.006	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Mercury	<	.002	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Nickel		.49	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Selenium		.007	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Silver	<	.006	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Thallium	<	.001	mg/L
01-MAY-02	WEDNESDAY	COMP_AUTO_HM	1100	Zinc		.806	mg/L
02-MAY-02	THURSDAY	GRAB	1100	Specific Conductance		7000	umhos/cm
02-MAY-02	THURSDAY	GRAB	1100	pH		8.1	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1140	Specific Conductance		6900	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1140	pH		8.9	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1240	Specific Conductance		6200	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1240	pH		8.8	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1340	Specific Conductance		5600	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1340	pH		8.7	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1440	Specific Conductance		5600	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1440	pH		8.6	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1540	Specific Conductance		5500	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1540	pH		8.7	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1640	Specific Conductance		5900	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1640	pH		8.7	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1740	Specific Conductance		6200	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1740	pH		8.7	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1840	Specific Conductance		6300	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1840	pH		8.7	pH
09-MAY-02	THURSDAY	1_Hr_COMP	1940	Specific Conductance		5800	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	1940	pH		8.7	pH
09-MAY-02	THURSDAY	1_Hr_COMP	2040	Specific Conductance		5600	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	2040	pH		8.8	pH
09-MAY-02	THURSDAY	1_Hr_COMP	2140	Specific Conductance		5500	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	2140	pH		8.9	pH
09-MAY-02	THURSDAY	1_Hr_COMP	2240	Specific Conductance		5500	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	2240	pH		8	pH
09-MAY-02	THURSDAY	1_Hr_COMP	2340	Specific Conductance		5100	umhos/cm
09-MAY-02	THURSDAY	1_Hr_COMP	2340	pH		8.8	pH
10-MAY-02	FRIDAY	1_Hr_COMP	40	Specific Conductance		4600	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	40	pH		9.1	pH
10-MAY-02	FRIDAY	1_Hr_COMP	140	Specific Conductance		7100	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	140	pH		7.2	pH
10-MAY-02	FRIDAY	1_Hr_COMP	240	Specific Conductance		5100	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	240	pH		9.2	pH
10-MAY-02	FRIDAY	1_Hr_COMP	300	Specific Conductance		2000	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	300	pH		7.6	pH
10-MAY-02	FRIDAY	1_Hr_COMP	340	Specific Conductance		4800	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	340	pH		9.1	pH
10-MAY-02	FRIDAY	1_Hr_COMP	440	Specific Conductance		4700	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	440	pH		9.4	pH
10-MAY-02	FRIDAY	1_Hr_COMP	540	Specific Conductance		5800	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	540	pH		9.4	pH
10-MAY-02	FRIDAY	1_Hr_COMP	640	Specific Conductance		5200	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	640	pH		8.9	pH
10-MAY-02	FRIDAY	1_Hr_COMP	740	Specific Conductance		5200	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	740	pH		8.8	pH
10-MAY-02	FRIDAY	1_Hr_COMP	840	Specific Conductance		12200	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	840	pH		8.5	pH
10-MAY-02	FRIDAY	1_Hr_COMP	940	Specific Conductance		18600	umhos/cm
10-MAY-02	FRIDAY	1_Hr_COMP	940	pH		8.7	pH
10-MAY-02	FRIDAY	COMP_AUTO_BOD	1030	Biochemical Oxygen Demand (BOD)		439	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_CN	1030	Total Cyanide	<	.02	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_COD	1030	Chemical Oxygen Demand		959	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Aluminum		.288	mg/
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Antimony	<	.015	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Arsenic	<	.003	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Barium		.134	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Beryllium	<	.006	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Cadmium	<	.009	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Chromium		3.87	mg/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Copper		.731	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Lead		.101	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Manganese		.011	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Mercury	<	.002	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Nickel		2.44	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Selenium		.014	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Silver	<	.006	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Thallium	<	.001	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_HM	1030	Zinc		2.51	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_MBAS	1030	Methylene Blue Active Substances		3.9	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_NH3	1030	Ammonia as (N)		9.72	mg/L
10-MAY-02	FRIDAY	COMP_AUTO_SOLID	1030	Total Suspended Solids		36	mg/L
10-MAY-02	FRIDAY	COMP_CONDUCT	1030	Specific Conductance		6600	umhos/cm
10-MAY-02	FRIDAY	COMP_PH	1030	pH		8.7	pH
10-MAY-02	FRIDAY	GRAB	1035	Specific Conductance		5300	umhos/cm
10-MAY-02	FRIDAY	GRAB	1035	pH		8.1	pH
10-MAY-02	FRIDAY	GRAB_BNA	1035	1,2,4-trichlorobenzene	<	11.1	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	1,2-diphenylhydrazine	<	8.45	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	2,4,6-trichlorophenol	<	8.87	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	2,4-dimethylphenol	<	11	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	2,4-dinitrophenol	<	8.98	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	2,4-dinitrotoluene	<	6	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	2,4_dichlorophenol	<	9.32	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	2,6-dinitrotoluene	<	6.97	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	2-chloronaphthalene	<	7.64	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	2-chlorophenol	<	5	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	2-nitrophenol	<	9.22	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	3,3-dichlorobenzidine	<	9.99	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	4-bromophenyl phenyl ether	<	6.04	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	4-chloro-3-methylphenol	<	7.16	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	4-chlorophenyl phenyl ether	<	4.99	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	4-nitrophenol	<	4.9	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Acenaphthene	<	5.45	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Acenaphthylene	<	8.34	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Anthracene	<	7.16	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Benzidine	<	6.17	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Benzo(A)anthracene	<	5.2	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Benzo(A)pyrene	<	7.69	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Benzo(G,H,I)perylene	<	5.22	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Benzo(K)fluoranthene	<	7.9	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Benzo(b)fluoroanthene	<	6.98	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Bis-(2-ethylhexyl) phthalate	<	7.87	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Butyl benzyl phthalate	<	7.53	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Chrysene	<	4.04	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Di-n-Butyl phthalate	<	5.89	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Di-n-Octyl phthalate	<	9.17	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Dibenzo (A,H) Anthracene	<	7.66	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Diethyl Phthalate	<	4.66	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Dimethyl Phthalate	<	4.64	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Fluoranthene	<	4.68	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Fluorene	<	4.04	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Hexachlorobenzene	<	6.89	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Hexachlorobutadiene	<	9.17	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Hexachlorocyclopentadiene	<	8.87	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Hexachloroethane	<	5.27	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Isophorone	<	6	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	N-nitrosodi-n-propylamine	<	8.67	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	N-nitrosodimethylamine	<	5.4	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	N-nitrosodiphenylamine	<	5.01	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Naphthalene	<	7.47	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Nitrobenzene	<	7.92	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Pentachlorophenol	<	2.73	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Phenanthrene	<	4.76	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Phenol	<	2.43	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	Pyrene	<	4.86	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	bis(2-chloroethoxy)methane	<	10.4	ug/L
10-MAY-02	FRIDAY	GRAB_BNA	1035	bis(2-chloroethyl) ether	<	6.41	ug/L
10-MAY-02	FRIDAY	GRAB_OG	1035	Hexane Extraction Method		19.8	mg/L
10-MAY-02	FRIDAY	GRAB_OG	1035	SGT-HEM-Non Polar Material	<	5	mg/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	Aldrin	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	Alpha Endosulfan	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	BHC, Alpha	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	BHC, Beta	<	.1	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
10-MAY-02	FRIDAY	GRAB_PEST	1035	BHC, Delta	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	BHC, Gamma (Lindane)	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	Beta Endosulfan	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	Chlordane	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	Dieldrin	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	Endosulfan Sulfate	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	Endrin	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	Endrin aldehyde	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	Heptachlor	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	Heptachlor epoxide	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	PCB 1016	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	PCB 1221	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	PCB 1232	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	PCB 1242	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	PCB 1248	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	PCB 1254	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	PCB 1260	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	PCB-1262	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	Toxaphene	<	.5	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	p,p-DDD	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	p,p-DDE	<	.1	ug/L
10-MAY-02	FRIDAY	GRAB_PEST	1035	p,p-DDT	<	.1	ug/L
17-MAY-02	FRIDAY	1_Hr_COMP	800	Specific Conductance		5300	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	800	pH		7.9	pH
17-MAY-02	FRIDAY	1_Hr_COMP	900	Specific Conductance		4300	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	900	pH		8	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1000	Specific Conductance		8200	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1000	pH		8	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1100	Specific Conductance		5700	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1100	pH		8.1	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1200	Specific Conductance		5800	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1200	pH		8.8	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1300	Specific Conductance		6100	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1300	pH		8.8	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1400	Specific Conductance		6200	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1400	pH		8.7	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1500	Specific Conductance		6200	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1500	pH		8.7	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1600	Specific Conductance		6300	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1600	pH		8.8	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1700	Specific Conductance		6000	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1700	pH		8.7	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1800	Specific Conductance		6200	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1800	pH		8.3	pH
17-MAY-02	FRIDAY	1_Hr_COMP	1900	Specific Conductance		17000	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	1900	pH		8.2	pH
17-MAY-02	FRIDAY	1_Hr_COMP	2000	Specific Conductance	>	20000	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	2000	pH		8.3	pH
17-MAY-02	FRIDAY	1_Hr_COMP	2100	Specific Conductance		6400	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	2100	pH		9.1	pH
17-MAY-02	FRIDAY	1_Hr_COMP	2200	Specific Conductance		7800	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	2200	pH		7.7	pH
17-MAY-02	FRIDAY	1_Hr_COMP	2300	Specific Conductance		9500	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	2300	pH		4.7	pH
17-MAY-02	FRIDAY	1_HR_COMP_METAL	2400	Antimony		.015	mg/L
17-MAY-02	FRIDAY	1_HR_COMP_METAL	2400	Arsenic		.019	mg/L
17-MAY-02	FRIDAY	1_HR_COMP_METAL	2400	Beryllium	<	.006	mg/L
17-MAY-02	FRIDAY	1_HR_COMP_METAL	2400	Cadmium	<	.009	mg/L
17-MAY-02	FRIDAY	1_HR_COMP_METAL	2400	Chromium		158	mg/L
17-MAY-02	FRIDAY	1_HR_COMP_METAL	2400	Copper		16.3	mg/L
17-MAY-02	FRIDAY	1_HR_COMP_METAL	2400	Lead		2.75	mg/L
17-MAY-02	FRIDAY	1_HR_COMP_METAL	2400	Mercury	<	.002	mg/L
17-MAY-02	FRIDAY	1_HR_COMP_METAL	2400	Nickel		322	mg/L
17-MAY-02	FRIDAY	1_HR_COMP_METAL	2400	Selenium		.021	mg/L
17-MAY-02	FRIDAY	1_HR_COMP_METAL	2400	Silver	<	.006	mg/L
17-MAY-02	FRIDAY	1_HR_COMP_METAL	2400	Thallium	<	.001	mg/L
17-MAY-02	FRIDAY	1_HR_COMP_METAL	2400	Zinc		101	mg/L
17-MAY-02	FRIDAY	1_Hr_COMP	2400	Specific Conductance		20000	umhos/cm
17-MAY-02	FRIDAY	1_Hr_COMP	2400	pH		2	pH
18-MAY-02	SATURDAY	PH_LOW	25	pH_Low_150.1		1.5	pH
18-MAY-02	SATURDAY	1_Hr_COMP	100	Specific Conductance		15000	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	100	pH		3.6	pH
18-MAY-02	SATURDAY	1_Hr_COMP	200	Specific Conductance		12000	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	200	pH		9.5	pH
18-MAY-02	SATURDAY	1_Hr_COMP	300	Specific Conductance		10000	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	300	pH		9.4	pH

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
18-MAY-02	SATURDAY	1_Hr_COMP	400	Specific Conductance		12000	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	400	pH		9.5	pH
18-MAY-02	SATURDAY	1_Hr_COMP	500	Specific Conductance		11000	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	500	pH		9.6	pH
18-MAY-02	SATURDAY	1_Hr_COMP	600	Specific Conductance		9000	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	600	pH		9.3	pH
18-MAY-02	SATURDAY	1_Hr_COMP	700	Specific Conductance		12000	umhos/cm
18-MAY-02	SATURDAY	1_Hr_COMP	700	pH		9.3	pH
18-MAY-02	SATURDAY	COMP_AUTO_BOD	1040	Biochemical Oxygen Demand (BOD)		488	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_CN	1040	Total Cyanide	<	.02	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_COD	1040	Chemical Oxygen Demand		1010	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Aluminum		.962	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Antimony	<	.015	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Arsenic		.006	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Barium		.326	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Beryllium	<	.006	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Cadmium	<	.009	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Chromium		13	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Copper		1.3	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Lead		.232	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Manganese		.024	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Mercury	<	.002	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Nickel		24.1	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Selenium		.007	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Silver	<	.006	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Thallium	<	.001	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_HM	1040	Zinc		8.03	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_NH3	1040	Ammonia as (N)		2.12	mg/L
18-MAY-02	SATURDAY	COMP_AUTO_SOLID	1040	Total Suspended Solids		89	mg/L
18-MAY-02	SATURDAY	COMP_CONDUCT	1040	Specific Conductance		9000	umhos/cm
18-MAY-02	SATURDAY	COMP_PH	1040	pH		7.8	pH
18-MAY-02	SATURDAY	GRAB	1050	Specific Conductance		7300	umhos/cm
18-MAY-02	SATURDAY	GRAB	1050	pH		9.6	pH
18-MAY-02	SATURDAY	GRAB_BNA	1050	1,2,4-trichlorobenzene	<	11.1	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	1,2-diphenylhydrazine	<	8.45	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	2,4,6-trichlorophenol	<	8.87	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	2,4-dimethylphenol	<	11	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	2,4-dinitrophenol	<	8.98	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	2,4-dinitrotoluene	<	6	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	2,4_dichlorophenol	<	9.32	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	2,6-dinitrotoluene	<	6.97	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	2-chloronaphthalene	<	7.64	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	2-chlorophenol	<	5	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	2-nitrophenol	<	9.22	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	3,3-dichlorobenzidine	<	9.99	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	4-bromophenyl phenyl ether	<	6.04	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	4-chloro-3-methylphenol	<	7.16	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	4-chlorophenyl phenyl ether	<	4.99	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	4-nitrophenol	<	4.9	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Acenaphthene	<	5.45	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Acenaphthylene	<	8.34	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Anthracene	<	7.16	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Benzidine	<	6.17	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Benzo(A)anthracene	<	5.2	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Benzo(A)pyrene	<	7.69	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Benzo(G,H,I)perylene	<	5.22	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Benzo(K)fluoranthene	<	7.9	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Benzo(b)fluoroanthene	<	6.98	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Bis-(2-ethylhexyl) phthalate	<	7.87	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Butyl benzyl phthalate	<	7.53	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Chrysene	<	4.04	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Di-n-Butyl phthalate	<	5.89	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Di-n-Octyl phthalate	<	9.17	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Dibenzo (A,H) Anthracene	<	7.66	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Diethyl Phthalate	<	4.66	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Dimethyl Phthalate	<	4.64	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Fluoranthene	<	4.68	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Fluorene	<	4.04	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Hexachlorobenzene	<	6.89	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Hexachlorobutadiene	<	9.17	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Hexachlorocyclopentadiene	<	8.87	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Hexachloroethane	<	5.27	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Isophorone	<	6	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
18-MAY-02	SATURDAY	GRAB_BNA	1050	N-nitrosodi-n-propylamine	<	8.67	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	N-nitrosodimethylamine	<	5.4	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	N-nitrosodiphenylamine	<	5.01	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Naphthalene	<	7.47	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Nitrobenzene	<	7.92	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Pentachlorophenol	<	2.73	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Phenanthrene	<	4.76	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Phenol	<	2.43	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	Pyrene	<	4.86	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	bis(2-chloroethoxy)methane	<	10.4	ug/L
18-MAY-02	SATURDAY	GRAB_BNA	1050	bis(2-chloroethyl) ether	<	6.41	ug/L
18-MAY-02	SATURDAY	GRAB_OG	1050	Hexane Extraction Method		14.3	mg/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	Aldrin	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	Alpha Endosulfan	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	BHC, Alpha	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	BHC, Beta	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	BHC, Delta	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	BHC, Gamma (Lindane)	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	Beta Endosulfan	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	Chlordane	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	Dieldrin	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	Endosulfan Sulfate	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	Endrin	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	Endrin aldehyde	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	Heptachlor	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	Heptachlor epoxide	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	PCB 1016	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	PCB 1221	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	PCB 1232	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	PCB 1242	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	PCB 1248	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	PCB 1254	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	PCB 1260	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	PCB-1262	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	Toxaphene	<	.5	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	p,p-DDD	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	p,p-DDE	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_PEST	1050	p,p-DDT	<	.1	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	1,1,1-trichloroethane	<	.78	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	1,1,2,2-tetrachloroethane	<	3.13	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	1,1,2-trichloroethane	<	3.02	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	1,1-dichloroethane	<	.71	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	1,1-dichloroethene	<	1.09	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	1,2-dichlorobenzene	<	1.37	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	1,2-dichloroethane	<	2.24	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	1,2-dichloropropane	<	.83	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	1,3-dichlorobenzene	<	1.31	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	1,4-dichlorobenzene	<	.99	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	2-chloroethylvinyl ether	<	1.35	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Benzene	<	.81	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Bromodichloromethane		2.26	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Bromoform	<	3.58	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Bromomethane	<	1.39	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Carbon tetrachloride	<	1.92	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Chlorobenzene	<	1	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Chloroethane	<	.95	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Chloroform		2.32	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Chloromethane	<	3.23	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Dibromochloromethane	<	1.99	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Ethylbenzene	<	1.46	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Methylene chloride	<	1.29	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Tetrachloroethene	<	1.04	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Toluene		1.33	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Trichloroethene	<	1.32	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Trichlorofluoromethane	<	3.92	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	Vinyl chloride	<	1.04	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	cis-1,3-dichloropropene	<	1.01	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	trans-1,2-dichloroethene	<	.61	ug/L
18-MAY-02	SATURDAY	GRAB_VOC	1050	trans-1,3-dichloropropene	<	1.27	ug/L
18-MAY-02	SATURDAY	PH_HIGH	1910	pH_High_150.1		11.4	pH

SITE 5

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
25-MAY-02	SATURDAY	1_Hr_COMP	1000	Specific Conductance		2600	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1000	pH		7.1	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1200	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1200	pH		7	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1300	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1300	pH		7	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1400	Specific Conductance		2300	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1400	pH		7	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1500	Specific Conductance		2300	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1500	pH		7	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1600	Specific Conductance		2400	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1600	pH		7.2	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1700	Specific Conductance		2300	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1700	pH		7.2	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1800	Specific Conductance		2300	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1800	pH		7.2	pH
25-MAY-02	SATURDAY	1_Hr_COMP	1900	Specific Conductance		2400	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	1900	pH		7.2	pH
25-MAY-02	SATURDAY	1_Hr_COMP	2000	Specific Conductance		2200	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	2000	pH		7.2	pH
25-MAY-02	SATURDAY	1_Hr_COMP	2300	Specific Conductance		2400	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	2300	pH		7.7	pH
25-MAY-02	SATURDAY	1_Hr_COMP	2400	Specific Conductance		2500	umhos/cm
25-MAY-02	SATURDAY	1_Hr_COMP	2400	pH		7.8	pH
26-MAY-02	SUNDAY	1_Hr_COMP	700	Specific Conductance		2900	umhos/cm
26-MAY-02	SUNDAY	1_Hr_COMP	700	pH		7.8	pH
26-MAY-02	SUNDAY	1_Hr_COMP	800	Specific Conductance		2700	umhos/cm
26-MAY-02	SUNDAY	1_Hr_COMP	800	pH		7.8	pH
26-MAY-02	SUNDAY	1_Hr_COMP	900	Specific Conductance		2700	umhos/cm
26-MAY-02	SUNDAY	1_Hr_COMP	900	pH		7.9	pH
26-MAY-02	SUNDAY	COMP_AUTO_BOD	1445	Biochemical Oxygen Demand (BOD)		316	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_CN	1445	Total Cyanide	<	.02	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_COD	1445	Chemical Oxygen Demand		791	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Aluminum		2.16	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Antimony	<	.015	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Arsenic		.003	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Barium		.533	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Beryllium	<	.006	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Cadmium	<	.009	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Chromium		.018	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Copper		.075	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Lead	<	.02	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Manganese		.043	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Mercury		.002	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Nickel		.019	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Selenium		.004	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Silver	<	.006	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Thallium	<	.001	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_HM	1445	Zinc		.707	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_NH3	1445	Ammonia as (N)		49.6	mg/L
26-MAY-02	SUNDAY	COMP_AUTO_SOLID	1445	Total Suspended Solids		188	mg/L
26-MAY-02	SUNDAY	COMP_CONDUCT	1445	Specific Conductance		2500	umhos/cm
26-MAY-02	SUNDAY	COMP_PH	1445	pH		7.4	pH
26-MAY-02	SUNDAY	GRAB	1455	Specific Conductance		2400	umhos/cm
26-MAY-02	SUNDAY	GRAB	1455	pH		7.5	pH
26-MAY-02	SUNDAY	GRAB_BNA	1455	1,2,4-trichlorobenzene	<	11.1	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	1,2-diphenylhydrazine	<	8.45	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	2,4,6-trichlorophenol	<	8.87	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	2,4-dimethylphenol	<	11	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	2,4-dinitrophenol	<	8.98	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	2,4-dinitrotoluene	<	6	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	2,4_dichlorophenol	<	9.32	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	2,6-dinitrotoluene	<	6.97	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	2-Methyl-4,6-Dinitrophenol	<	9.6	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	2-chloronaphthalene	<	7.64	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	2-chlorophenol	<	5	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	2-nitrophenol	<	9.22	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	3,3-dichlorobenzidine	<	9.99	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	4-bromophenyl phenyl ether	<	6.04	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	4-chloro-3-methylphenol	<	7.16	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	4-chlorophenyl phenyl ether	<	4.99	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	4-nitrophenol	<	4.9	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Acenaphthene	<	5.45	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Acenaphthylene	<	8.34	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Anthracene	<	7.16	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Benzidine	<	6.17	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
26-MAY-02	SUNDAY	GRAB_BNA	1455	Benzo(A)anthracene	<	5.2	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Benzo(A)pyrene	<	7.69	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Benzo(G,H,I)perylene	<	5.22	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Benzo(K)fluoranthene	<	7.9	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Benzo(b)fluoroanthene	<	6.98	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Bis-(2-chloroisopropyl) ether	<	8.93	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Bis-(2-ethylhexyl) phthalate		35.5	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Butyl benzyl phthalate	<	7.53	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Chrysene	<	4.04	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Di-n-Butyl phthalate	<	5.89	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Di-n-Octyl phthalate	<	9.17	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Dibenzo (A,H) Anthracene	<	7.66	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Diethyl Phthalate		72.5	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Dimethyl Phthalate	<	4.64	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Fluoranthene	<	4.68	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Fluorene	<	4.04	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Hexachlorobenzene	<	6.89	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Hexachlorobutadiene	<	9.17	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Hexachlorocyclopentadiene	<	8.87	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Hexachloroethane	<	5.27	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Indeno(1,2,3-CD)pyrene	<	7.7	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Isophorone	<	6	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	N-nitrosodi-n-propylamine	<	8.67	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	N-nitrosodimethylamine	<	5.4	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	N-nitrosodiphenylamine	<	5.01	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Naphthalene	<	7.47	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Nitrobenzene	<	7.92	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Pentachlorophenol	<	2.73	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Phenanthrene	<	4.76	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Phenol	<	2.43	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	Pyrene	<	4.86	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	bis(2-chloroethoxy)methane	<	10.4	ug/L
26-MAY-02	SUNDAY	GRAB_BNA	1455	bis(2-chloroethyl) ether	<	6.41	ug/L
26-MAY-02	SUNDAY	GRAB_OG	1455	Hexane Extraction Method		60.5	mg/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	Aldrin	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	Alpha Endosulfan	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	BHC, Alpha	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	BHC, Beta	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	BHC, Delta	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	BHC, Gamma (Lindane)	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	Beta Endosulfan	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	Chlordane	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	Dieldrin	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	Endosulfan Sulfate	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	Endrin	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	Endrin aldehyde	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	Heptachlor	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	Heptachlor epoxide	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	PCB 1016	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	PCB 1221	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	PCB 1232	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	PCB 1242	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	PCB 1248	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	PCB 1254	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	PCB 1260	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	PCB-1262	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	Toxaphene	<	.5	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	p,p-DDD	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	p,p-DDE	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_PEST	1455	p,p-DDT	<	.1	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	1,1,1-trichloroethane	<	.78	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	1,1,2,2-tetrachloroethane	<	3.13	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	1,1,2-trichloroethane	<	3.02	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	1,1-dichloroethane	<	.71	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	1,1-dichloroethene	<	1.09	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	1,2-dichlorobenzene	<	1.37	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	1,2-dichloroethane	<	2.24	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	1,2-dichloropropane	<	.83	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	1,3-dichlorobenzene	<	1.31	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	1,4-dichlorobenzene		5.43	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	2-chloroethylvinyl ether	<	1.35	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Benzene	<	.81	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Bromodichloromethane	<	1.79	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Bromoform	<	3.58	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Bromomethane	<	1.39	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Carbon tetrachloride	<	1.92	ug/L

DATE	DAY OF WEEK	SAMPLE_TYPE	TIME	ANALYTE	Q	VALUE	UNITS
26-MAY-02	SUNDAY	GRAB_VOC	1455	Chlorobenzene	<	1	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Chloroethane	<	.95	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Chloroform		3.32	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Chloromethane	<	3.23	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Dibromochloromethane		2.99	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Ethylbenzene	<	1.46	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Methylene chloride	<	1.29	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Tetrachloroethene	<	1.04	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Toluene		2.3	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Trichloroethene	<	1.32	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Trichlorofluoromethane	<	3.92	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	Vinyl chloride	<	1.04	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	cis-1,3-dichloropropene	<	1.01	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	trans-1,2-dichloroethene	<	.61	ug/L
26-MAY-02	SUNDAY	GRAB_VOC	1455	trans-1,3-dichloropropene	<	1.27	ug/L